

A review of the UK and British Channel Islands practical tidal stream energy resource

Coles, Daniel; Angeloudis, Athanasios; Greaves, Deborah; Hastie, Gordon; Lewis, Matthew; Mackie, Lucas; McNaughton, James; Miles, Jon; Neill, Simon; Piggott, Matthew; Risch, Denise; Scott, Beth; Sparling, Carol; Stallard, Tim; Thies, Philipp; Walker, Stuart; White, David; Willden, Richard; Williamson, Benjamin J.

Proceedings of the Royal Society A

DOI:

[10.1098/rspa.2021.0469](https://doi.org/10.1098/rspa.2021.0469)

Published: 24/11/2021

Peer reviewed version

[Cyswllt i'r cyhoeddiad / Link to publication](#)

Dyfyniad o'r fersiwn a gyhoeddwyd / Citation for published version (APA):

Coles, D., Angeloudis, A., Greaves, D., Hastie, G., Lewis, M., Mackie, L., McNaughton, J., Miles, J., Neill, S., Piggott, M., Risch, D., Scott, B., Sparling, C., Stallard, T., Thies, P., Walker, S., White, D., Willden, R., & Williamson, B. J. (2021). A review of the UK and British Channel Islands practical tidal stream energy resource. *Proceedings of the Royal Society A*, 477(2255), Article 20210469. <https://doi.org/10.1098/rspa.2021.0469>

Hawliau Cyffredinol / General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal ?

Take down policy

If you believe that this document breaches copyright please contact us providing details, and we will remove access to the work immediately and investigate your claim.

A review of the UK and British Channel Islands
practical tidal stream energy resource

Daniel Coles^{a,*}, Athanasios Angeloudis^b, Deborah Greaves^a, Gordon Hastie^d,
Matthew Lewis^e, Lucas Mackie^c, James McNaughton^f, Jon Miles^a, Simon
Neill^c, Matthew Piggott^c, Denise Risch^g, Beth Scottⁱ, Carol Sparling^d, Tim
Stallard^h, Philipp Thies^j, Stuart Walker^j, David White^k, Richard Willden^f,
Benjamin Williamson^l

^a*School of Engineering, Computing and Mathematics, Faculty of Science and Engineering,
University of Plymouth, Plymouth PL4 8AA, UK*

^b*School of Engineering, Institute for Infrastructure and the Environment, The University of
Edinburgh, Edinburgh, EH8 9YL, UK*

^c*Department of Earth Science and Engineering, Imperial College London, London, SW7
2AZ, UK*

^d*Sea Mammal Research Unit, Scottish Oceans Institute, University of St Andrews, St
Andrews, Fife, KY16 8LB, UK*

^e*School of Ocean Sciences, Bangor University, Menai Bridge LL59 5AB, UK*

^f*Department of Engineering Science, University of Oxford, Parks Road, Oxford, OX1 3PJ,
UK*

^g*The Scottish Association for Marine Science, Oban, PA37 1QA, UK*

^h*Department of Mechanical, Aerospace and Civil Engineering, Faculty of Science and
Engineering, University of Manchester, Manchester, M1 3BB, UK*

ⁱ*School of Biological Sciences, University of Aberdeen, AB24 AB24 2TZ, UK*

^j*Renewable Energy Group, CEMPS, University of Exeter, Penryn Campus, Penryn,
Cornwall, TR10 9FE, UK*

^k*School of Engineering, University of Southampton, University Road, Southampton, SO17
1BJ, UK*

^l*Environmental Research Institute, North Highland College, University of the Highlands and
Islands, Ormlie Road, Thurso, KW14 7EE, UK*

Abstract

This review provides a critical, multi-faceted assessment of the practical contribution tidal stream energy can make to the UK and British Channel Islands future energy mix. Evidence is presented that broadly supports the latest national-scale practical resource estimate, of 34 TWh/year, equivalent to 11% of the UK's current annual electricity demand. The size of the practical resource depends in part on the economic competitiveness of projects. In the UK, 124 MW of prospective tidal stream capacity is currently eligible to bid for subsidy support (MeyGen 1C; 80 MW, PTEC; 30 MW, and Morlais; 14 MW). It is estimated that a further 124 MW would serve to drive down levelised cost of energy (LCoE), through learning, from its current level, of around 240 £/MWh,

*Corresponding author

Email address: daniel.coles@plymouth.ac.uk (Daniel Coles)

to below 150 £/MWh, based on a mid-range technology learning rate of 17%. Doing so would make tidal stream cost competitive with technologies such as combined cycle gas turbines, biomass and anaerobic digestion. Installing this 124 MW by 2031 would put tidal stream on a trajectory to install the estimated 11.5 GW needed to generate 34 TWh/year by 2050. The cyclic, predictable nature of tidal stream power shows potential to provide additional, whole-system cost benefits. These include reductions in balancing expenditure, that are not considered in conventional LCoE estimates. The practical resource is also dependent on environmental constraints. To date, no collisions between animals and turbines have been detected, and only small changes in habitat have been measured. The impacts of large arrays on stratification, and predator-prey interaction, are projected to be an order of magnitude less than those from climate change, highlighting opportunities for risk retirement. Ongoing field measurements will be important as arrays scale up in size, with a focus on the environmental and ecological impacts that cannot yet be modelled accurately enough. Based on the findings presented in this review, we recommend that an updated national-scale practical resource estimate is undertaken, that implements high-fidelity, site-specific modelling, with improved validation from the wide range of field measurements that are now available at major sites. Quantifying the sensitivity of the practical resource to constraints will be important to establish opportunities for constraint retirement. Quantification of whole-system benefits will be important to fully understand tidal streams value in the energy mix.

Keywords: Tidal stream power, tidal stream energy, practical resource, cost of energy, system integration, environmental impact

1. Introduction

The UK generates approximately 308 TWh of electricity a year [1]. Of this, 40% is produced using fossil fuels, such as coal and natural gas, that contribute more than 20% of the UK's annual greenhouse gas emissions [2]. In 2019, the UK legislated net-zero greenhouse gas emissions by 2050, necessitating the replacement of carbon emitting electricity generation technologies with clean alternatives. The Climate Change Committee's 6th carbon budget estimates that electricity demand will increase to between 550 - 680 TWh/year by 2050, driven predominantly by the electrification of transport and heating [3]. Wind and solar pv generation are estimated to contribute 430 TWh and 85 TWh/year respectively, totalling 515 TWh/year. Complimentary technologies are required to make up the remaining shortfall in supply, and overcome the grid management challenges that increasing levels of variable power production will present, such as balancing.

Tidal stream turbines harness the power of the tides, typically using horizontal axis rotors to drive a generator. Since 2008, 18 MW of tidal stream capacity has been installed in the UK. Of this, 10.4 MW is operational, with

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60

the remaining 7.7 MW now decommissioned having completed testing [4]. The growth in UK tidal stream cumulative installed capacity is shown in Figure 1, alongside progress globally, and that of UK fixed-bed offshore wind [5]. The emergence of operational tidal stream projects has been dependant on access to government subsidy. Between 2008 and 2015, tidal stream was supported by the Renewable Obligations Certificate (ROC) scheme. Electricity suppliers purchase ROCs from renewable power generators to fulfill their obligation to provide renewable electricity, whilst providing the generator with an income per unit of energy supplied [6]. The Contracts for Difference (CfD) scheme was introduced in 2015 to replace ROCs. The CfD scheme protects generators from volatile wholesale electricity prices by providing a flat rate for electricity production to a renewable power generator, known as the strike price, over 15 years. Developers can apply for CfD support through biennial auction rounds (AR), where projects with the lowest strike price are selected for CfD support. The first 3 CfD rounds since 2015 (AR1-3) have provided subsidy support for approximately 11.2 GW of installed capacity. 10.8 GW has been won by fixed-bed offshore wind projects [7, 8, 9], which have a significantly lower strike price, achieved through earlier adoption along with steady subsidy support. To date, tidal stream projects, which currently have a relatively high strike price, have not been able to secure CfD support. This has slowed the rate of tidal stream deployment since 2015 significantly, as shown Figure 1.

To be eligible to bid in CfD auction rounds, projects must have secured a lease plot, grid connection and consents. For AR4, scheduled for late 2021, three tidal stream projects are eligible to bid; Morlais in Wales (14 MW), the Perpetuus Tidal Energy Centre (PTEC) in England (30 MW), and MeyGen 1C in Scotland (80 MW). Projects that win subsidy support in AR4 must be operational from 2026. The projected UK cumulative installed capacity, as a result of these projects being built out, is shown in Figure 1, alongside a projection by the Offshore Renewable Energy Catapult that is discussed in §3. The UK and British Channel Islands estimated tidal stream installed capacity potential is 11.5 GW, which is discussed further in §2. Figure 1 shows that for 11.5 GW to be installed by 2050, the deployment trajectory must return to its pre-2015 level, to reach a cumulative installed capacity of approximately 60 MW (i.e. a combination of Morlais, PTEC and/or MeyGen 1C) before 2027, and 140 MW (i.e. Morlais, PTEC and MeyGen 1C) before 2031.

Details of tidal stream installations, both in the UK and elsewhere, are provided in Table 1. In general, information on the energy/power performance of operational projects is scarce. Of the performance data that is available, UK projects have demonstrated relatively low levels of overall capacity factor (<0.2), calculated based on the entire period since commissioning. This is partly down to the fact that to date, most operational turbines have been deployed for testing purposes, with lower performance targets than commercial projects. Over the development of some 58 tidal stream projects globally since 2003, there has been a marked improvement in turbine reliability, achieved through learning from early-stage turbine deployments at lower flow sites [10]. Verdant Power have reported energy yield figures of 0.3 GWh over a 9 month period, equivalent

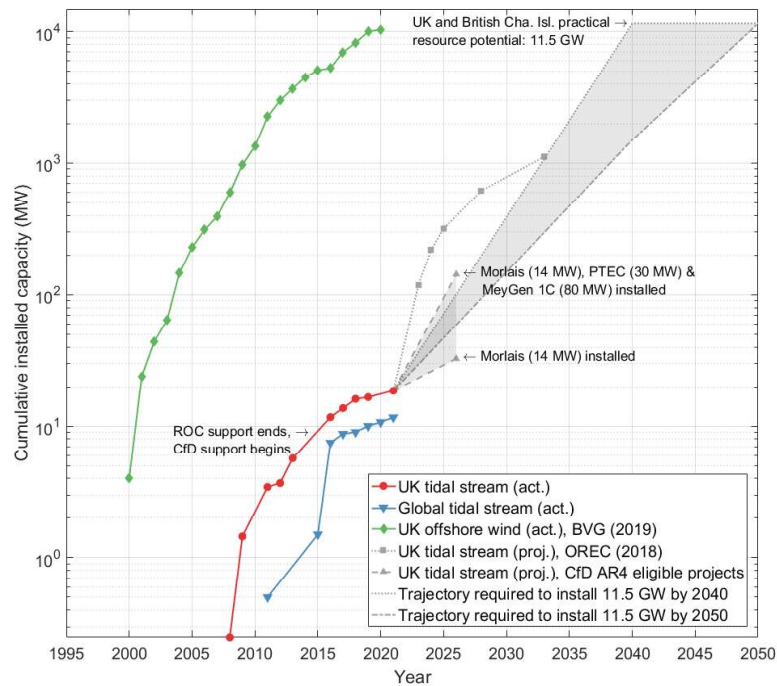


Figure 1: Actual and projected cumulative installed capacity of tidal stream and fixed-bed offshore wind in the UK and globally (excluding the UK).

to a capacity factor of 0.42 [11]. Demonstrating the commercial viability of tidal stream relies on further evidence of sustained high power performance.

Table 1: Tidal stream installed capacity in the UK and globally. Capacity factors estimated based on the energy yield achieved between the following dates: [†]SR2000: October 2016 - September 2018, [‡]MeyGen 1A: December 2016 - July 2021, [‡]Alstom DeepGen: January 2013 - December 2014, [†]MCT SeaGen: July 2008 - July 2019, [†]Verdent Gen5: 9 month period (dates not available).

Developer	Project/site	Turbine model(s)	Rotors	Start of operation	Installed capacity	Active	Energy yield	Capacity factor
UK projects								
Orbital Marine Power*	EMEC testing	O2	2	2021	2.00 MW	Yes	N/A	N/A
Minesto	Holyhead Deep Phase 1	DG500	1	2019	0.50 MW	Yes	N/A	N/A
Magallanes	EMEC testing	ATIR	2	2018	2.00 MW	Yes	N/A	N/A
Nova Innovation	Shetland Tidal Array	M100-D	4	2018	0.40 MW	Yes	N/A	N/A
Orbital Marine Power*	EMEC testing	SR2000	2	2017	2.00 MW	No	3.3 GWh	0.10 [†]
MeyGen	MeyGen 1A	HS1500, AR1500	4	2016	6.00 MW	Yes	37.0 GWh	0.16 [‡]
Tidal Energy Ltd	Ramsey Sound	DeltaStream	1	2015	0.40 MW	No	N/A	N/A
Alstom	EMEC testing	Deepgen	1	2013	1.00 MW	No	1.2 GWh	0.07 [‡]
Voith Hydro	EMEC testing	HyTide 1000	1	2013	1.00 MW	No	N/A	N/A
Orbital Marine Power*	EMEC testing	SR250	2	2012	0.25 MW	No	N/A	N/A
SIMEC Atlantis Energy	EMEC testing	AR1000	1	2011	1.00 MW	No	N/A	N/A
Andritz Hydro Hammerfest	EMEC testing	HS1000	1	2011	1.00 MW	No	N/A	N/A
Marine Current Turbines (MCT)	Strangford Lough testing	SeaGen	2	2009	1.20 MW	No	11.6 GWh	0.10 [†]
OpenHydro	EMEC testing	N/A	1	2008	0.25 MW	No	N/A	N/A
Global projects								
SIMEC Atlantis Energy	Naru Strait, Japan	AR1500	1	2021	0.50 MW	Yes	N/A	N/A
Sustainable Marine Energy/Schottel	Pemba'q, Instream Tidal Energy project, Grand Passage, Canada	PLAT-I 6.40	6	2020	0.42 MW	Yes	N/A	N/A
Verdant Power	The RITE Project, East River, New York, USA	Gen5	3	2020	0.11 MW	Yes	0.3 GWh	0.42 [‡]
SIMEC Atlantis Energy	Zhoushan archipelago, China	SG500	1	2020	0.50 MW	Yes	N/A	N/A
Minesto	Vestmannasund, Faroe Islands	DG100	2	2020	0.10 MW	Yes	N/A	N/A
HydroQuest	Paimpol-Brehat, France	N/A	4	2019	1.00 MW	Yes	N/A	N/A
Sustainable Marine Energy	Digby Neck, Canada	PLAT-I 4.63	4	2018	0.28 MW	Yes	N/A	N/A
Tocado	Eastern Scheldt, Netherlands	T-2	5	2017	1.25 MW	Yes	N/A	N/A
OpenHydro	Paimpol-Brehat, France	L'Arcouest	2	2016	4.00 MW	No	N/A	N/A
OpenHydro	FORCE, Canada	N/A	1	2016	2.00 MW	No	N/A	N/A
Sabella	Fromveur Passage, France	D10	1	2015	1.00 MW	Yes	N/A	N/A
OpenHydro	Paimpol-Brehat, France	N/A	1	2011	0.50 MW	No	N/A	N/A

*Formerly ScotRenewables

1
2
3
4
5
6
7
8 In 2020, the UK Government Department for Business, Energy and Industrial
9 Strategy (BEIS), and the UK Parliament Environmental Audit Committee,
10 issued calls for evidence to assess the contribution tidal stream can make to the
11 UK's future power generation mix [12, 13]. Based on the evidence submitted,
12 the Environmental Audit Committee concluded that "there is substantial po-
13 tential for the tidal sector to make a significant and distinct contribution to the
14 UK's future mix of energy generated from renewable sources" [14]. Since the
15 call, BEIS have announced that for the first time, AR4 will allow tidal stream to
16 compete for subsidy support against other less-established technologies such as
17 floating offshore wind, without competition from fixed-bed offshore wind [15].

18 This review expands on information submitted to the BEIS and Environmen-
19 tal Audit Committee calls for evidence by the authors. We focus on the current
20 state of the art in UK practical tidal stream energy resource quantification. The
21 practical resource is defined as the annual energy yield potential that can be
22 harnessed using tidal stream turbines, once consideration for economic, envi-
23 ronmental, regulatory and social constraints have been imposed [16, 17]. The
24 validity of the latest national-scale practical resource estimates are reviewed in
25 §2. This includes discussion regarding the inclusion of constraints, including
26 those arising from regulation, such as laws/regulations that enable/prohibit the
27 use of marine areas, and socially, such as those arising from navigation. The eco-
28 nomic viability of tidal stream is reviewed in §3, with consideration for levelised
29 cost of energy (LCoE), and the cost competitiveness of tidal stream relative
30 to other technologies. A summary of cost reduction drivers is also provided in
31 Appendix A. The cost competitiveness, and therefore practical resource, are
32 also dependent on the ease to which tidal stream projects can integrate with
33 the grid, and complement other technologies, such as energy storage. These
34 aspects are explored in §4. The environmental impacts of large-scale array de-
35 velopment are critical in assessing the practical viability of future tidal stream
36 projects. Impacts such as changes to sediment dynamics, collision risk with ma-
37 rine animals, and habitat change, are reviewed in §5. Examples of the linkages
38 between these practical resource considerations are summarised in Figure 2, and
39 discussed throughout the review.
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60

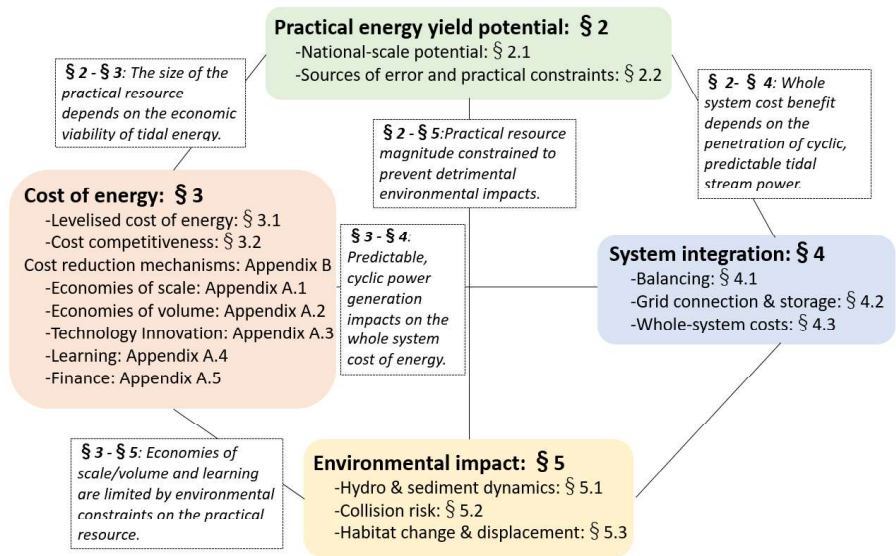


Figure 2: Summary of review topics, with example of how they are related to one another.

2. Practical energy yield potential

2.1. National-scale potential

The Carbon Trust commissioned the latest UK-wide tidal stream practical resource study in 2011 [16]. The study used the shallow water 2D hydrodynamic model Tidal Flow Development-2d (TFD-2D) [18] to simulate generic hydraulic current, resonant basin and tidal streaming sites. The model domains (e.g. channel length/width/depth) were modified to approximately match the geometry of 31 sites. The locations of the sites are shown in Figure 3, alongside other sites and lease plots that are discussed in this review. The models were forced by the principal semi-diurnal lunar constituent (M2) only. Sites were selected for the study if they exhibited depths greater than 15 m, and an estimated mean annual power density that exceeded 1.5 kW/m². These criteria were set based on the conditions required for economic viability of operational tidal stream turbines at the time. An additional drag term was implemented in the momentum equations to simulate the impacts of blockage caused by tidal stream turbine rotors on the surrounding flow field. Additional drag sources from infrastructure such as the support structures were excluded from the analysis. Constraints on changes to the flow regime (i.e. tidal range and flow speeds), and grid and array spatial extent were implemented to establish practical limits on energy extraction.

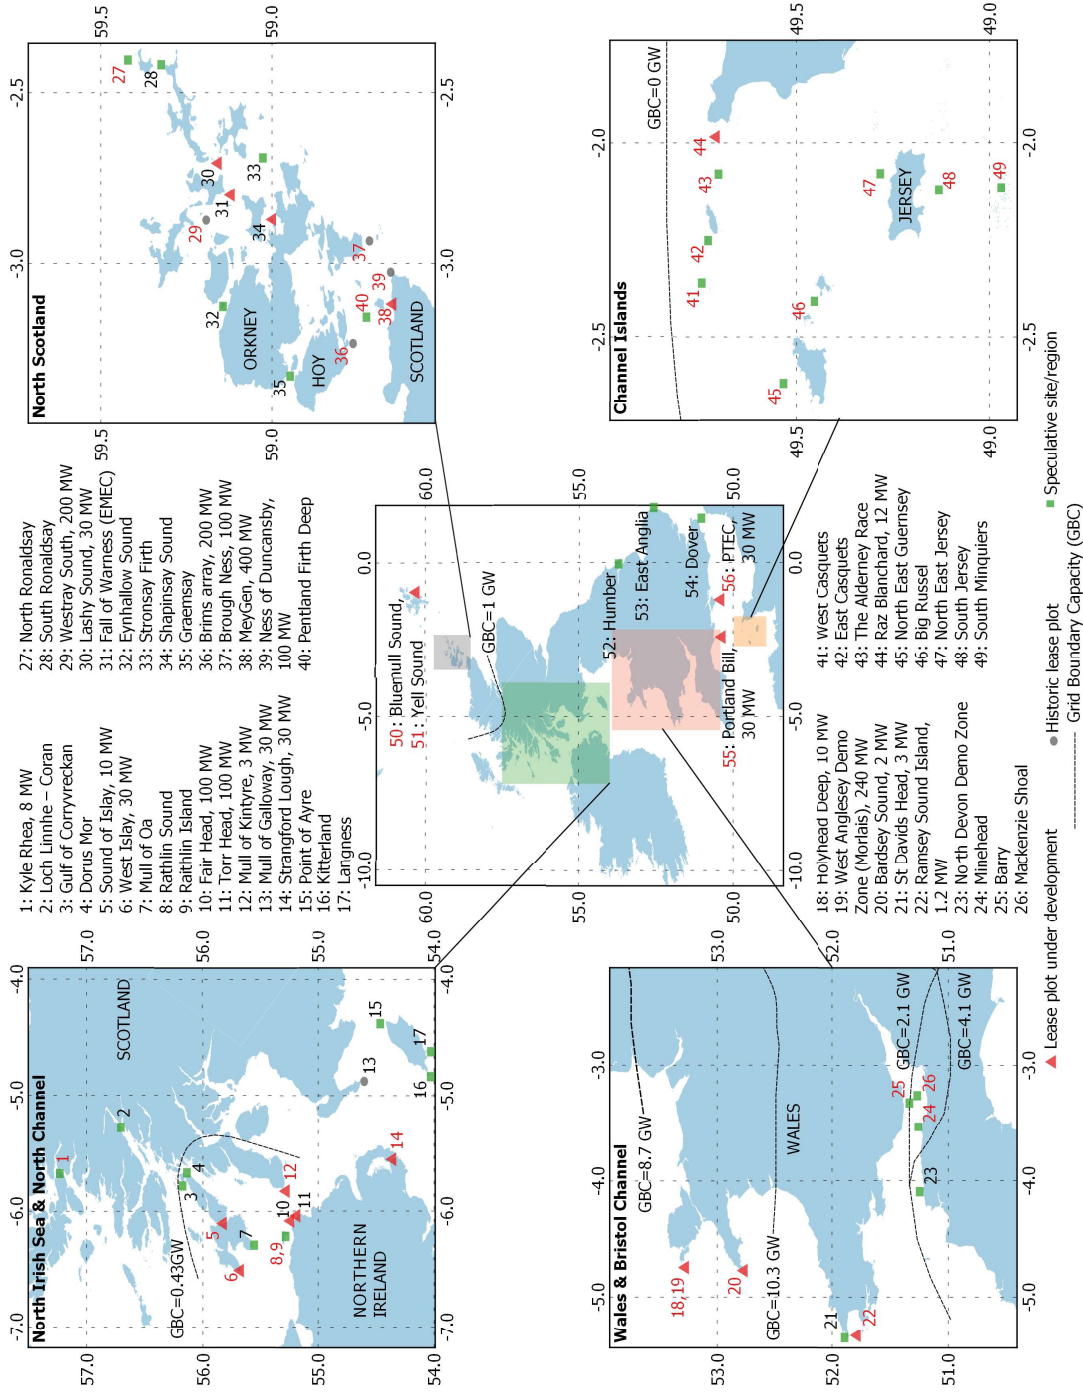


Figure 3: Overview of prospective tidal stream energy lease sites and speculative sites around the UK and British Channel Islands. Red triangles indicate lease plots currently under development, green squares indicate lease plots that have been withdrawn, and green squares indicate speculative sites/regions. Red numbers indicate sites/regions considered in the 2011 Carbon Trust study [16]. Relevant electrical grid boundary capacities (GBC) are also illustrated.

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60

The initial estimated practical resource potential, of 21 TWh/year, is equivalent to 6.5% of the UK's annual electricity demand, and a time-averaged annual power output of 2.4 GW. The Carbon Trust study re-estimated the practical resource based on relaxed cost constraints applied to the tidal streaming and Pentland Firth sites. It was argued that high levels of development in the Pentland Firth region would enable favourable economic mechanisms, such as greater economies of volume, relative to smaller sites (see Appendix A for discussion on cost-reduction mechanisms). Environmental constraints were also relaxed on all tidal streaming sites, on the grounds that the generic hydrodynamic models used were not representative of the 'open-sea' sites considered in the study. The re-estimated practical resource, of 34 TWh/year, is equivalent to 11% of the UK's current annual electricity demand.

The significant increase in the practical resource from this re-estimate (i.e. from 21 TWh/year to 34 TWh/year) highlights high sensitivity to the economic and environmental constraint limits. The Carbon Trust study acknowledges that sensitivity testing of the arbitrarily prescribed practical limits on energy extraction is required on a site-by site basis, including improved understanding of the acceptable ambient flow changes, given that they have no regulatory basis. The validity of assumptions regarding constraint setting are now discussed.

Figure 4 quantifies the estimated installed capacity required to achieve the Carbon Trust 34 TWh/year yield. These are compared with the capacity currently under development at each site. In the case of the Alderney Race, the installed capacity requirement has been halved, since half of the Race is located in French territorial waters. Site locations are shown in Figure 3, along with others identified around the UK and British Channel Islands. The required installed capacities were estimated based on a capacity factor 0.34, which considers all system losses to the grid connection [19]. In total, 11.5 GW of installed capacity is required to produce 34 TWh/year.

In the Pentland Firth, 6 GW of installed capacity is required. Subsequent hydrodynamic modelling of the Pentland Firth simulated a 4.2 GW array, demonstrating that a capacity factor of 0.39 (without system losses) may be achievable [20]. This work also demonstrated that some environmental impacts caused by the array, such as increased stratification, are an order of magnitude lower than those caused by global warming. The total area of the Pentland Firth site used in the Carbon Trust study is 260 km². A 6 GW array requires an array density of 23 MW/km². This is equivalent to a lateral and longitudinal spacing between turbines of 8 rotor diameters and 25 rotor diameters respectively, based on the specification of the MeyGen 1A turbines. This is significantly higher than the minimum lateral and longitudinal spacing recommended by EMEC, of 2.5 rotor diameters and 10 rotor diameters respectively [21]. These findings support the Carbon Trust approach to relax economic and environmental constraints imposed on the Pentland Firth region, however further investigation is required to quantify (a) the potential impacts of constraints that were neglected in the Carbon Trust study on the practical resource, and (b) the magnitude of errors in the practical resource estimate. In §2.2 we quantify the latter.

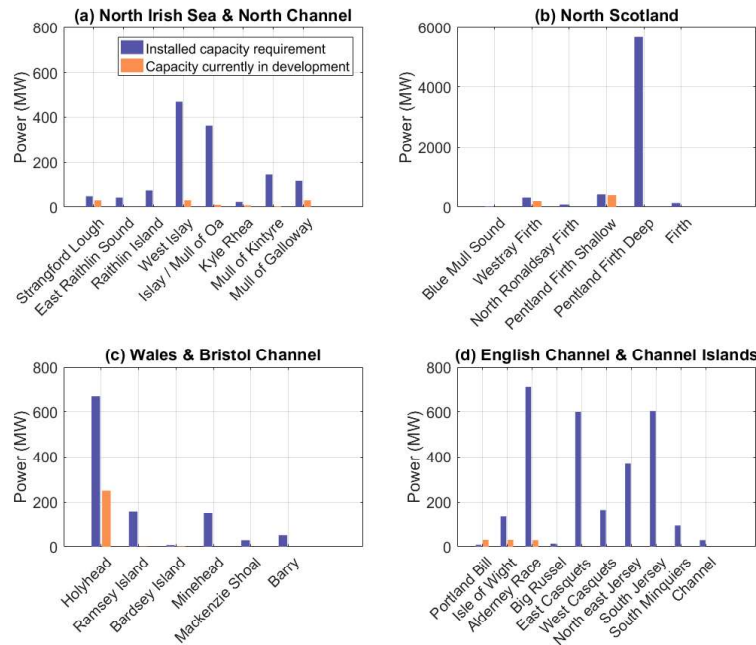


Figure 4: Installed capacity requirement to achieve a practical resource of 34 TWh/year with a capacity factor of 0.34, based on sites used in the 2011 Carbon Trust study [16]. Note that (b) North Scotland has a different y-axis limit, given its larger resource.

2.2. Sources of error and practical constraints

The Carbon Trust practical resource estimates have a reported uncertainty of -50%/+20%. Since the time of the study, research developments have brought to light the potential contribution of errors arising from the methods adopted by the Carbon Trust. These are as follows:

- The hydrodynamic models use M2 forcing only. This accounts for around 85% of the tidal stream energy [22], resulting in a 15% under-estimation in energy yield.
- Energy yield was estimated based upon 'mean spring flow' and 'mean neap flow' speeds. This method has since been shown to under-predict the energy resource by up to 25% [23].
- The study excluded sites due to unavailability of field data, including the Point of Ayre, Langness and Kitterland in the Isle of Man, which have been considered for development with a combined installed capacity of 210 MW.

1
2
3
4
5
6
7
8 Additionally, Stronsay Firth (measured peak flow speeds of 2 m/s and
9 depths of 30 – 35 m [24]), Dorus Mor (high-energy site with maximum
10 flow speeds of 4.1 m/s), Orkney Papa Westray, Eday Sound (understood
11 to be Lashy Sound, a 30 MW site currently under development), and
12 Yell Sound in Shetland [25] were not included. An additional twenty one
13 relatively low capacity sites have been identified as potentially suitable for
14 tidal stream energy development, and are shown in Figure 3. Based on
15 the proposed install capacities of the Isle of Mann sites, they are expected
16 to increase the practical resource by at least 2.5%.

- 17 • The accuracy of the approach to represent real sites by generic tidal
18 streaming, hydraulic current and resonant basin domains was investigated,
19 using Strangford Lough as a test case [26]. It was shown that the generic
20 domain simulation underestimated the resource by 10%, compared to a hy-
21 drodynamic model that used the specific site geometry, bathymetry and
22 forcings. Only partial validation of the TFD-2D models was undertaken,
23 as at the time of the study, field data availability was limited.
- 24 • The estimates do not consider the support structure drag of the turbines,
25 which if included, would increase the blockage effects of the arrays, result-
26 ing in greater levels of flow diversion away from the turbines, and hence
27 a reduction in energy yield [27, 28]. Haverson et al. (2018) parameterised
28 the support structure drag of monopiles in a hydrodynamic model that
29 simulated an array of turbines located at St David's Head in Wales [29].
30 Adopting the same rotor and drag parameterisation, with a monopile drag
31 coefficient of 0.9, monopile diameter of 2 m, and exposed monopile area
32 of 15 m^2 , we estimate that the contribution of support structure drag, as
33 a percentage of the total device drag, is less than 5%, at the rated speed
34 of the turbine. This is based on a flow with a $1/7^{th}$ power law boundary
35 layer profile, and a MeyGen 1A turbine rotor, with a diameter of 18 m,
36 rated speed of 3 m/s, hub height of 14 m, and rotor drag coefficient of 0.8
37 [30].

38
39 From this we conclude that the overestimation in practical resource arising
40 from neglecting support structure drag does not outweigh error sources that
41 have caused the practical resource to be underestimated.

42
43 Resource estimates from studies conducted since the Carbon Trust assess-
44 ment are compared in Table 2, focusing on the Pentland Firth and Alderney
45 Race as they exhibit the greatest tidal stream resource. Advancements have
46 been made in the accuracy of hydrodynamic modelling through improved fi-
47 delity and temporal/spatial resolution, as well as improved validation, enabled
48 through a greater availability of field measurements [31, 32]. The most recent
49 studies include at least 8 tidal constituent forcings. All studies simulate the
50 impacts of blockage caused by the turbine rotor drag, but exclude the contribu-
51 tion of support structure drag. The majority of the studies adopt a 2-D (depth
52 averaged) modelling approach. Model validation demonstrates that these ap-
53 proaches are capable of capturing key tidal driven processes across the regional,
54
55
56
57
58
59
60

array and turbine scales, and at acceptable computational cost [32]. 3-D hydrostatic (layered) models, such as the ones implemented by O'Hara Murray et al. (2017) and De Dominicis et al. (2018) [33, 20] are most useful in cases where high turbine density causes wakes to impinge on downstream turbines, and/or in stratified flow, for example. They are significantly more computationally expensive, which can prohibit the number of model runs, if different array designs need to be considered, for example. Fully 3-D, non-hydrostatic models are practically used for meso-scale and device-scale simulations that look to resolve fine scale bathymetric features and individual turbines/turbine blades [34, 35, 36], but are too computationally expensive to cover the regional and array scales necessary to estimate the practical resource.

As discussed, DeDominicis et al. (2018) provides a promising insight into the economic and environmental viability of a large array in the Pentland Firth. However all of the Pentland Firth studies simulate arrays that span the majority of the Channel width, thereby neglecting and regulatory and social constraints that may limit the practical resource [37, 33, 20].

In the Alderney Race, economic, environmental and social constraints have been considered to an extent. Coles et al. (2020) simulated an array that leaves a central channel for shipping [28], based on an array originally set out in [38]. The study also quantifies changes to the flow field as a result of blockage close to a large sandbank located south of Alderney [28]. Goss et al. (2020) implemented optimisation using gradient-based algorithms [39, 40, 41] to establish the footprint of arrays that minimise cost of energy [42]. However, both studies acknowledge that sub-optimal rotor diameter and rated power of the turbines considered result in sub-optimal array performance, with capacity factors of 0.18 and 0.15 respectively, so further iterations on array design are required. Studies investigating the environmental impacts of smaller arrays in the Pentland Firth and Alderney Race, with installed capacities an order of magnitude lower than the expected practical levels, are reviewed in §5.

Table 2: Summary of time-averaged power estimates for the Pentland Firth, Scotland, and the Alderney Race, in the Channel Islands.

Study	Boundary forcings	2D/3D	Constraints considered			Array layout and other considerations	Mean Power
			Econ.	Env.	Reg. Soc.		
Pent. Firth							
Carbon Trust (2011) [16]	1	2D	✓	✓	✗	NA	0.9 GW
Carbon Trust (2011) [16]	1	2D	✓	✓	✗	Environmental and economic constraints relaxed	2.0 GW
Adcock et al. (2013) [37]	2	2D	✗	✗	✗	3 rows of turbine spanning the Pentland Firth, blockage ratio of 0.4.	2.0 GW
Adcock et al. (2013) [37]	2	2D	✗	✗	✗	1 row of turbine spanning the Pentland Firth, blockage ratio of 0.4.	1.0 GW
Adcock et al. (2013) [37]	2	2D	✗	✗	✗	1 row of turbine spanning the Pentland Firth, blockage ratio of 0.25.	0.5 GW
O'Hara Murray et al. (2017) [33]	2	3D	✓	✓	✗	1 row of turbines spanning the Pentland Firth, turbines occupy the bottom 25 m of the water column	1.4 GW
De Dominicis et al. (2018) [20]	8	3D	✗	✓	✗	4.2 GW array spanning the Pentland Firth in waters deeper than 27.5 m.	1.6 GW
Ald. Race							
Carbon Trust (2011) [16]	1	2D	✓	✓	✗	Environmental and economic constraints applied.	0.18 GW
Carbon Trust (2011) [16]	1	2D	✓	✓	✗	Environmental and economic constraints relaxed.	0.20 GW
Coles et al. (2017) [27]	1	2D	✗	✗	✗	Rows of turbines spanning entire width of Alderney Race, array density constrained to 0.038	1.40 GW
Coles et al. (2020) [28]	8	2D	✓	✗	✗	2 GW array covering the majority of the Race, with a central channel left free for shipping	0.36 GW
Goss et al. (2020) [42]	9	2D	✓	✓	✗	2.7 GW array, layout optimised for cost of energy, with constraints on array density	0.4 GW

Figure 3 shows that the Crown Estate Scotland has allocated 400 MW of lease capacity in the Pentland Firth at MeyGen, and 40 MW around Islay (West Islay Tidal Project; 30 MW, Sound of Islay; 10 MW). The Crown Estate Scotland has withdrawn lease plots from its portfolio, such as the Ness of Duncansby; 100 MW, Brough Ness; 200 MW and Brims; 200 MW), all located in the shallower regions of the Pentland Firth. In addition, the Westray lease plot in Orkney Waters (200 MW), and the Mull of Galloway lease plot on the west coast of Scotland (30 MW), have been withdrawn. At Holyhead, The Crown Estate has awarded a 10 MW agreement for lease at Holyhead Deep, and there are plans to build-out the West Anglesey Tidal Demonstration Zone, also known as Morlais, currently up to 240 MW. In the Alderney Race, a total of 29 MW is being developed in its French territorial waters (Raz Blanchard), by Normandie Hydroliennes (12 MW) and Hydroquest (17 MW). There is currently a significant discrepancy between the required installed capacity to achieve 34 TWh/year, of 11.5 GW, and the 1 GW of allocated lease capacity currently available. This may not seem of immediate concern, given that increasing total installed capacity from its current level to 1 GW will take time. However, considerable spatial planning effort is required to establish if the required lease plot capacity can be allocated at each site/region. This will require joined up thinking between hydrodynamic modellers, sea-space commissioners, sea users and local communities.

Evidence has been provided that supports the 34 TWh/year practical resource estimate made by the Carbon Trust study. However, the validity of the estimate relies partly on the accuracy of hydrodynamic modelling. We identify a need to update the national-scale practical resource estimate that has relied on models with generic site geometries, and limited validation data, with site-specific studies. The validity of the 34 TWh/year estimate also relies on the practical constraints neglected in the study having an insignificant impact on the practical resource, relative to the ones implemented. This highlights a need to establish the sensitivity of the practical resource to individual constraints, to identify constraints that may reduce the practical resource, and opportunities for retiring others. Research in this area can guide development of standards for resource assessment, such as IEC 62600-201 [43], in order to disseminate best practises and enhance the adoption of practical constraints in resource modelling.

3. Cost of energy

3.1. Levelised cost of energy

LCoE is a metric commonly used to compare the economic performance of different energy projects [44]. It is the ratio of the total lifetime cost of a project, to the energy output over its lifetime. LCoE projections are highly sensitive to capital and operational expenditure (referred to as CapEx and OpEx respectively). Typically, future CapEx and OpEx are estimated using a technology learning rate, defined as the percentage reduction in costs with every doubling of

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60

cumulative installed capacity. Whilst multiple factors will drive cost-reduction, such as economies of scale and technology innovations (see Appendix A for examples of these cost-reduction drivers), technology learning rate combines all cost-reduction factors [45]. Typically, CapEx and OpEx projections adopt a wide range of technology learning rates of between 9 - 17% [46, 47, 48, 49, 10]. Cost data from operational projects demonstrates that to date, tidal stream has achieved a technology learning rate of 25% [4]. Future CapEx and OpEx projections also require an assumption to be made regarding the future cumulative installed capacity. The sensitivity of LCoE to technology learning rate, and cumulative installed capacity, is demonstrated in Figure 5. LCoE data provided by the Offshore Renewable Energy Catapult is based on information provided directly by tidal stream project developers [4]. Based on this data, learning rate starts at 25% during the early phases of development, then reduces to around 15% after cumulative installed capacity exceeds 100 MW. Other technology learning rates range between 9 -17%, resulting in significantly different future LCoE projections, ranging between 80 - 140 £/MWh after 1 GW of cumulative installed capacity, for example.

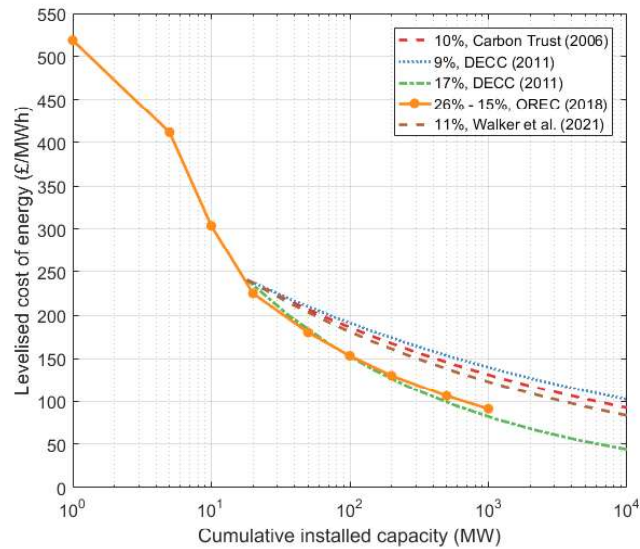


Figure 5: Relationship between cumulative installed capacity and levelised cost of energy, based on a range of technology learning rates reported in literature.

Figure 6 compares actual LCoE data from operational projects, with LCoE projections provided by the Offshore Renewable Energy Catapult (OREC) [4], and BEIS [44]. The LCoE of global onshore wind [50] and UK fixed-bed offshore wind [51] are also plotted for comparison. Tidal stream is on a steep cost reduction trajectory, where the installation of the first 8 MW of tidal stream

capacity in the UK led to a reduction in the LCoE of approximately 25%, to around 300 £/MWh [4]. This is similar to the cost reduction rate achieved by onshore wind between 1985 and 1990 [50].

We find that the OREC projections are likely to underestimate future LCoE. The projections assume that cumulative installed capacity increases at a rate of 100 MW/year, from 2021/22. This projected build-out rate is shown in Figure 1, and is now acknowledged to be unachievable, if projects are to rely on CfD subsidy support, which may only facilitate this level of build-out to commence around 2026. A counter argument to this is that OREC's LCoE projections are based on aggregated data from multiple tidal stream turbine developers, with devices ranging from kW to MW scale [4]. The LCoE of larger devices is likely to fall below the aggregated projection as a result of economies of scale, as described in Appendix A.1.

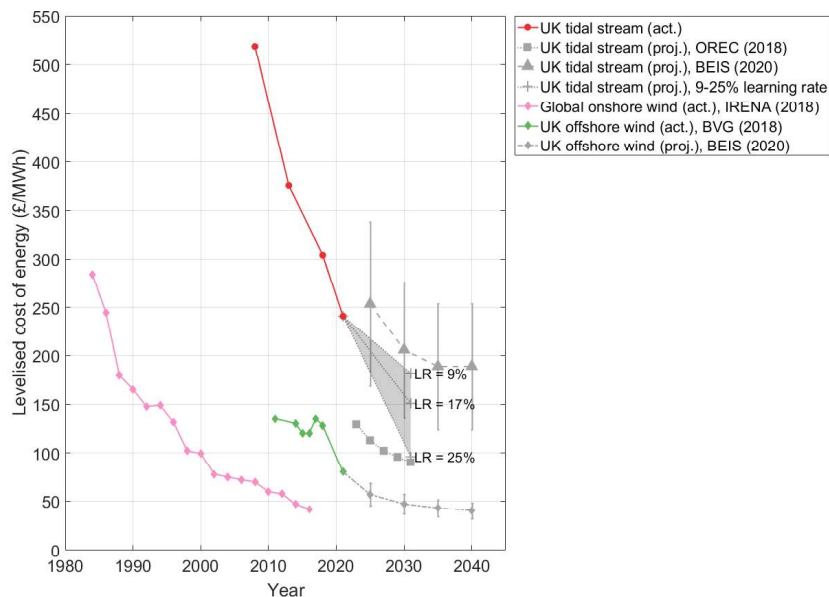


Figure 6: LCoE of tidal stream [4, 44], UK fixed-bed offshore wind [51], and global onshore wind [50], based on actual data from operational projects, and projections. Tidal stream LCoE projections are given based on learning rates (LR) ranging between 9 - 25%.

BEIS provide “high” and “low” LCoE projections, based on a pessimistic to optimistic range of CapEx and OpEx inputs respectively. Error bars in Figure 6 indicate these high and low LCoE projections. BEIS use a high CapEx for an 18 MW array installed in 2025 of approximately 8.1 m £/MW, showing close agreement with MeyGen 1A’s reported CapEx, of 8.6 m £/MW [19]. BEIS use

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60

a high OpEx cost of approximately 0.7 m/year, only half the reported OpEx of MeyGen 1A [19]. Construction costs, which contribute to CapEx, are subject to a learning rate that is equivalent to a cost reduction of 1%/year [48]. This cost reduction has been implemented up to 2030, with no further increase in cumulative installed capacity after 2030. LCoE projections are all based on an 18 MW array. These assumptions regarding increases to cumulative installed capacity, and individual array scale, neglect the full impacts of economies of volume, and learning, on LCoE. The BEIS 2025 high projections lie above the reported 2018 LCoE of tidal stream from operational projects, of 304 £/MWh [4]. It is therefore likely that neglected cost reduction from learning and economies of volume outweigh the cost reduction caused by underestimating CapEx and OpEx.

Figure 6 also provides three 2031 LCoE projections, based on findings from this review. In all three cases, the 2031 cumulative installed capacity is estimated to be 160 MW. The first contribution to this is the UKs current cumulative installed capacity, of 18 MW. The second is 124 MW of additional capacity installed in the UK at sites that are currently eligible to bid for CfD support; Morlais (14 MW), PTEC (30 MW) and MeyGen 1C (80 MW). The third is an additional 18 MW installed outside the UK, derived by linearly extrapolating the global cumulative installed capacity (excluding the UK) achieved to date, which is shown in Figure 1. A 2031 installed capacity of 142 MW in the UK and British Channel Islands is necessary to put it on a trajectory to achieve its practical resource potential of 11.5 GW by 2050, as illustrated in Figure 1. The LCoE projections adopt a technology learning rate of 9% ,17% and 25%, reflecting the extreme and mid-range estimates in the literature, and the technology learning rate achieved to date from operational projects. These yield 2031 LCoE estimates of 182 £/MWh, 150 £/MWh and 96 £/MWh respectively. The mid-range LCoE estimate of 150 £/MWh by 2031 falls between the BEIS and OREC LCoE projections, as expected for the reasons discussed. It also aligns with cost data collected from turbine developers by OREC, that was used to estimate that approximately 1 GW of cumulative installed capacity would be needed to achieve an LCoE of 90 £/MWh [4], as shown in Figure 5. Given the high sensitivity of LCoE to technology learning rate, it will be important to monitor its progression with cumulative installed capacity in the future, to update LCoE projections if necessary.

3.2. Cost competitiveness

In September 2021, BEIS announced that tidal stream energy projects will be eligible to compete for CfD subsidy support in AR4 “pot 2” [15]. As well as tidal stream, pot 2 includes advanced conversion technologies (such as gasification), dedicated biomass with CHP, floating offshore wind, geothermal, remote island wind(>5 MW) and wave. Pot 2 has a budget of 55 £million/year, with 24 £million/year ring-fenced for floating offshore wind only. All budgets are based on 2011/12 prices. Consideration by BEIS for ring-fencing of other technologies is ongoing, and will be decided before the auction round starts in December 2021. The administrative strike price, which defines the minimum strike price projects of a particular technology can bid for, is shown for each

technology in Figure 7. Administrative strike price is only indicative of the cost competitiveness of different technologies. However, given the vast difference in administrative strike price between tidal stream, of 211 £/MWh, and competing technologies such as remote island wind, of 62 £/MWh, it is unlikely that tidal stream will be able to win subsidy support in AR4, unless a ring-fence is introduced for it.

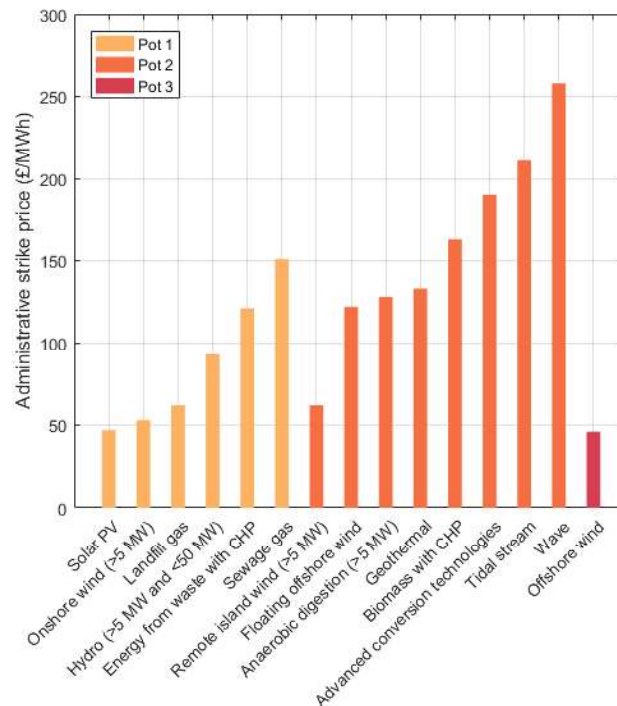


Figure 7: Comparison of AR4 pot 2 technology administrative strike prices, based on 2011/12 prices [15]

Figure 8 provides LCoE projections for a wide range of power generation technologies. With the exception of tidal stream, data is based on 2025 and 2040 LCoE projections provided by BEIS [44]. The 2031 tidal stream LCoE projection is based on previously stated conclusions, that support a mid-range LCoE of 150 £/MWh, and lower and upper bounds of 96 £/MWh and 182 £/MWh respectively. The current LCoE of tidal stream is also shown [4]. The projections indicate that by 2031, the LCoE of tidal stream has the potential to become competitive with that of combined cycle gas turbines (both H class and with CHP), Biomass with CHP, anaerobic digestion, geothermal with CHP, and advanced conversion technologies.

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60

Figure 8 shows that the estimated cost reduction trajectory of tidal stream is steeper than the majority of other technologies, including those in AR4 pot 2. For the LCoE of tidal stream to become competitive with the 2040 LCoE of nuclear, of around c. 90 £/MWh), the global cumulative installed capacity of tidal stream must reach approximately 1 GW, based on a technology learning rate of 17%. This is equivalent to 9% of the estimated total installed capacity required to generate the UK practical resource, of 11.5 GW, suggesting significant further cost reduction is likely with further tidal stream installations after 1 GW. These two findings support the argument for a ring-fence to be introduced for tidal stream in AR4.

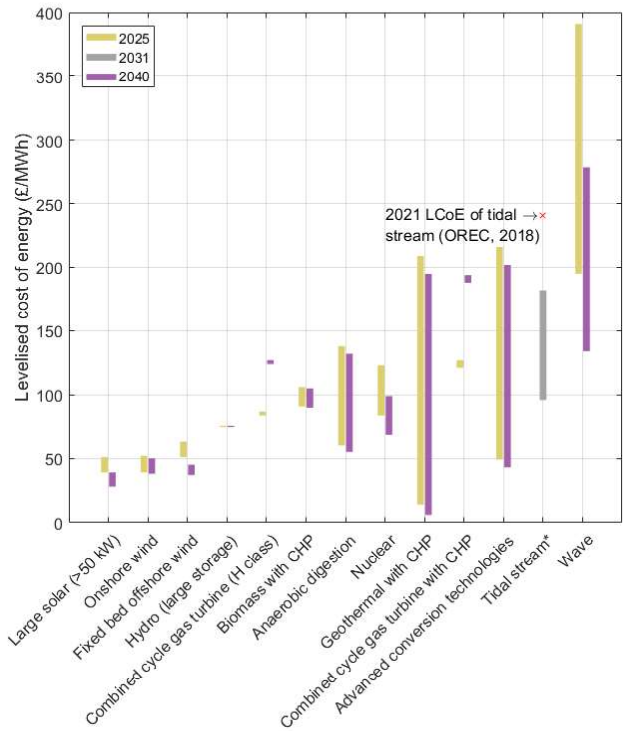


Figure 8: Comparison of 2025, 2031 and/or 2040 LCoE projections for different technologies [44], based on 2011/12 prices.
*Tidal stream projection based on findings presented in this review.

Developed technologies such as wind and solar are on a flatter cost-reduction trajectory to 2040, having already reduced cost through their earlier adoption. The LCoE of combined cycle gas turbine (CCGT) technologies (both H Class and CHP mode) is projected to increase to levels exceeding 120 £/MWh by 2040. Currently, the UK has approximately 32 GW of CCGT capacity that

supplies over 25% of the UK's annual electricity demand. Importantly, CCGT is capable of providing dispatchable generation in periods of low renewable energy resource, so it is likely to play an important role in the coming years as more variable renewable capacity is connected to the grid. The same may also be true of biomass, which currently provides around 11% of the UK's electricity demand, but at much higher projected cost that is not expected to reduce significantly between 2025 and 2040.

4. System integration

4.1. Balancing

In the 2019 offshore wind sector deal, UK Government identified the grid integration of variable generation as a key challenge for the industry as renewable power penetration increases [52]. Balancing between supply and demand is central to this challenge. Resource availability defines the percentage of time a generation resource is available for supplying demand. In comparison to other variable generators, tidal stream has been shown to exhibit relatively high resource availability [53], in part due to the cyclic nature of the tides [54]. These characteristics of tidal power generation are described here.

The UK has semi-diurnal tides with a period slightly greater than 12 hours [55]. In this period the tides complete a flood-ebb cycle, with slack water separating flood and ebb tides. Tidal stream power generation occurs in periods when the cut-in speed of the turbine is exceeded, and ceases during slack water. The resulting power signal has approximately four periods of generation per day, every day. This semi-diurnal cycle of flow speeds is shown in Figure 9a. Figure 9b provides the typical hourly capacity factor of a tidal stream turbine over the same time period. Power generation is greatest during spring tides, when alignment between the sun, earth and moon, known as syzygy, maximises the tide generating force. Neap tides exhibit lower-flow speeds, and therefore power, due to mis-alignment between the sun, earth and moon. These daily variations in flow speed and capacity factor are shown in Figure 9c and 9d respectively. The variation in flow speed caused by the spring neap cycles over a year are shown in Figure 9e. Since the distribution of spring and neap tides are similar over each month, monthly capacity factors remain fairly consistent at around 0.4, as shown in Figure 9f. At longer time scales, the tides are affected by the 18.6 year lunar nodal cycle, which is mainly driven by variation in the inclination of the moons orbital path relative to the equatorial plane of the Earth. The annual capacity factor of turbines (Figure 9h) shows approximately a +/- 10% variation in yearly capacity factor over this period.

In contrast, variations in the monthly capacity factor of the UK's wind energy fleet can vary significantly. On average, the monthly capacity factor of wind power is approximately 0.3, but over June 2014 it dropped to 0.11 [56] as a result of a large scale weather system [57]. A similar drop in capacity factor from the UK's proposed 40 GW offshore wind power capacity in 2030 [58] would result in a reduction in power of approximately 7.6 GW, equivalent to

approximately 20% of the UK's current time-averaged electrical power demand. When the available wind power exceeds the grid capacity, power is typically curtailed. Between 2015 and 2020, the curtailment of UK wind energy has increased from 1.22 TWh/year to 3.82 TWh/year, rising approximately in line with annual wind energy generation. The cost implications of the impacts of variability on balancing are reviewed in §4.3.

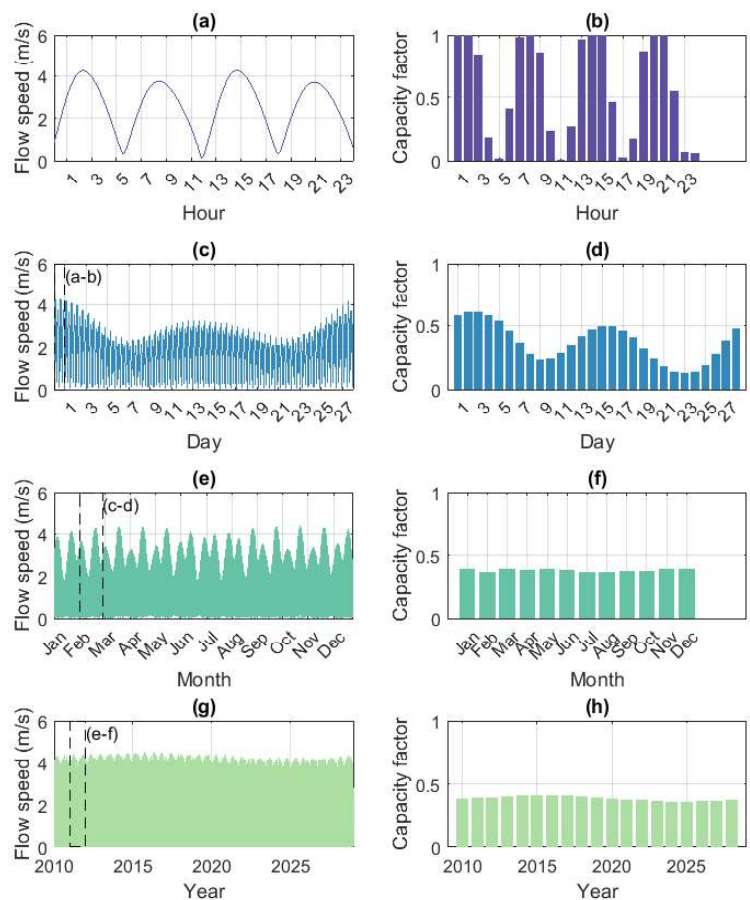


Figure 9: Demonstration of the cyclic, predictable nature of tidal flow and generated power, over timescales of (a-b) a single day, (c-d) a month, (e-f) a year, and (g-h) 19 years.

The predictability of the tides is also an important advantage for system balancing. With knowledge of astronomical cycles, tidal elevations and velocities can be predicted at sub-hour resolution far into the future using numerical models and harmonic analysis [55, 59, 60]. This high certainty over future generation can reduce the level of intervention required to achieve system balancing, relative to more unpredictable technologies [61]. In contrast to tidal stream energy, variable power generation technologies tend to exhibit relatively high levels of forecasting uncertainty, which can lead to power balancing shortfalls [53]. A study of Spanish wind power forecasts shows that the mean absolute error in average production reduced from approximately 15% two days in advance, to around 6%, 1 hour in advance [62]. At high penetrations, the magnitude of the uncertainty in instantaneous power generation will be significant, requiring larger, more rapid, and more costly interventions to balance and stabilise the system [63, 64, 65, 66, 67, 68]. These costs are discussed in §4.3.

4.2. Grid connection and storage

Regions of highest tidal stream resource in the UK are located in remote areas, where electricity demand is low, and access to the transmission grid is constrained. Regional grid constraints are illustrated in Figure 3, through mapping of grid boundary capacity (GBC). GBC is defined as the net power transfer limit between regions [69]. For the UK and British Channel Islands to meet the current practical resource estimate of 34 TWh/year, it is estimated that 6 GW and 2 GW of tidal stream capacity must be installed in the Pentland Firth and British Channel Islands respectively. Both regions also exhibit high wind resources that have started to be developed, with future development planned, making the regions net exporters of renewable power. The Pentland Firth and Channel Islands currently have grid boundary capacities of 1 GW and 0 GW respectively, limiting/preventing any future large tidal stream power from being transmitted to high demand centres. Grid studies have found that sites in North Scotland will require significant reinforcement with long development time frames [70].

Wales and the Bristol Channel region have relatively high grid boundary capacities, of 10.3 GW and 2.1 GW respectively. High demand centres such as Swansea, Cardiff and Bristol are in relatively close proximity to the tidal stream resource in the Bristol Channel. It is expected that tidal generation at sites such as Portland Bill and those in the Bristol Channel will be able to connect into the transmission and distribution network close to the shore without significant grid reinforcement [70]. Other sites on the south coast of England and in Wales, are likely to require some grid reinforcements back to inshore substations or the transmission network, and/or longer subsea cables. It is estimated that the grid around the North Irish Sea and North Channel is capable of exporting around 20 MW, but higher export power will require significant onshore reinforcements and long subsea cables.

The cyclic nature of tidal power production is well-suited for integration with short-term energy storage (<4 hours) to help balance supply with local demand [71, 72, 73, 74, 54]. During spring tides, excess tidal power is used

to charge the battery. During slack water periods, the battery discharges to meet demand. The cycle then repeats. Periods of no tidal power generation (i.e. slack water) last for approximately 2-3 hours, so energy storage systems with the same storage duration allow power to be supplied during these low tidal resource periods. This can be achieved using lithium-ion batteries [75] or flow batteries [76]. During neap tides, reliance on back-up power increases. This type of embedded generation can prevent the need to reinforce connections with the transmission grid.

Commercial tidal stream projects have now started adopting energy storage. The 0.4 MW Shetland tidal stream turbine array has been connected to lithium-ion battery to provide continuous power [75]. The Orbital Marine Power (previously Scotrenewables) SR2000 and Tocado TFS and T2 tidal turbines have been used to generate hydrogen at the European Marine Energy Centre (EMEC) [77]. EMEC has also announced that it will combine tidal stream power with a 1.8 MWh flow battery to power its hydrogen production plant [76].

4.3. Whole-system costs

Conventionally, LCoE does not account for the whole-system costs incurred by different generation technologies as a result of balancing, grid reinforcement and transmission [62, 63]. This is consistent with the data presented in §3. Whole-system costs are defined as the change in costs that are incurred from constructing and operating the power system with the addition of a new plant [63]. The whole-system cost will depend on the prevalence of complementary technologies, forecast accuracy and the size of variable plant considered relative to the transmission capacity. “Enhanced” LCoE (eLCoE) accounts for these whole-system costs to provide a more well-rounded representation of cost of energy. BEIS estimate that the eLCoE of UK fixed-bed offshore wind in 2035 will be between 60 - 80 £/MWh. This is 50 - 100% higher than its projected 2035 LCoE, of 40 £/MWh [44].

Whilst the eLCoE of tidal stream remains unclear, initial studies show that diversifying a 100% wind portfolio that generates 120 TWh/year, by replacing 25% of its energy production with an even split of tidal stream and wave energy, reduces balancing expenditure by approximately 700 £m/year [78]. These cost savings are achieved by reducing back-up capacity, reduced costs of reserve capacity and reduced fuel costs. This cost saving is equivalent to approximately 3% of the annual wholesale cost of electricity. Given this potentially high cost saving, further work is required to strengthen these findings, by quantifying the whole-system cost and eLCoE of tidal stream, to compare against competing technologies, using accepted approaches such as those set out in [79].

5. Environmental impact

5.1. Hydro and sediment dynamics

Large scale energy extraction by tidal stream turbine arrays modifies the surrounding ambient flow field as a result of the added turbine drag. In general,

tidal stream turbine arrays cause an increase in upstream tidal elevation, and a downstream decrease, typically of a few centimetres [27, 80]. Flow speeds are seen to increase around arrays, and reduce in the array wake [28]. Flow speed reduction can decrease the energy of tidal mixing, perturbing the balance between stratification and vertical mixing processes. Importantly, the impact of large arrays on stratification has been shown to be an order of magnitude lower than those caused by climate change [20].

O'Hara Murray et al (2017) [33] investigated far-field impacts from energy extraction in the Pentland Firth by simulating a row of turbines spanning the width of the Firth, covering the lower 25 m of the water column, with a time-averaged power of 1.4 GW [33]. It was estimated that the array would reduce the time-averaged volume flux through the Pentland Firth by 7%. Flow speeds in the Firth reduced by around 0.5 m/s, and the tidal range within the Pentland Firth and Scapa Flow was modified by 0.1 m.

The transport of sediment is approximately related to current speed cubed; therefore even a modest change in the velocity field from turbine installations can lead to a significant impact on sediment dynamics [81]. This will depend on the number of turbines, their proximity to sedimentary deposits and site-specific characteristics such as the hydrodynamics and the sediment type/amount/distribution. Near-field impacts include scour, which may affect array operation, whilst far-field effects could impact upon the structure of larger features such as sandbanks. Typically, high-energy tidal stream sites are characterised by low levels of sediment, as the ambient flows winnow finer sediment, leaving coarser sediment and bed-rock. However, sediment can accumulate in lower-flow regions of high-energy sites, as is seen at MeyGen [82, 83] and the Alderney Race. [84, 85], as well as headland sites associated with energetic tidal flows, such as Portland Bill [86].

A 2015 study investigated the cumulative effect of MeyGen (86 MW), Ness of Duncansby (95 MW), Bough Ness (99 MW) and Brims array (200 MW), in the Pentland Firth, on sediment transport [87]. Positively, results indicate that the arrays cause minimal modification to the baseline morphodynamics of neighbouring large sandbanks, suggesting changes to the ambient flow field are unlikely to cause detrimental impact to sediment morphology. Results from modelling of energy extraction around Holyhead, Wales, indicate that arrays with an installed capacity of up to 50 MW reduce flow speeds locally by a few percent [88]. This change is negligible relative to the natural flow variability. Model predictions show that when the array capacity increased to over 50 MW, sedimentary processes were significantly affected, but that energy extraction was unlikely to alter bed shear levels past their natural levels of variability further afield (10 km away from the array). A similar study at MeyGen found that changes to natural patterns in sediment migration are possible once the array capacity exceeds approximately 85 MW, where flow diversion around the array may cause long-term accumulation of coarse sediment and gravel in the centre of the array and scouring and removal of existing sediment deposits to the north and south of the array [89]. These findings are consistent with those in other studies [90, 91]. Another study looked at the impact of 300 MW arrays on

sediment transport around the Alderney South Banks, a large sand bank to the south of Alderney in the Alderney Race caused by a large eddy system [92, 85]. Results show that most of the high-energy array locations considered would be unlikely to affect the flow field in the vicinity of the South Banks; however in some cases, the array caused asymmetrical modifications to the flow and sedimentary regime. These finding must be caveated with the acknowledgement that numerical modelling of sediment dynamics is highly challenging, in part due to the large range of temporal and spatial scales involved [85], as well as uncertainties in aspects such as the suspended and bedload sediment supply in and out of the regions modelled [89].

In summary, hydro and sediment-dynamics modelling to date highlights that as arrays scale up in size, they have the potential to modify the surrounding flow field and sediment transport. Given the relatively high level of uncertainty in sediment transport models, there is a need for complimentary field measurement campaigns that track the changes arrays of increasing size make to surrounding sediment dynamics. Impacts on sediment transport are closely linked to the proximity of arrays to sedimentary deposits. Clearly this consideration should be prioritised in the spatial planning of large arrays to help mitigate detrimental impacts.

5.2. Collision risk

There is a longstanding concern that marine mammals, fish and diving seabirds could be injured or killed as a result of collisions with the rotating blades of tidal turbines, in a similar fashion to birds colliding with wind turbines [93, 94, 95]. In general, for a small number of marine mammal species, monitoring around single turbines and small arrays has provided evidence of avoidance in the range of 100s to 1000s of metres which would lead to lower estimates of collision risk compared to worst-case assumptions [96, 97, 98, 99, 100]. A recent study provided the first evidence for fine-scale evasion of an operation tidal turbine by harbour porpoises [101].

Monitoring has provided evidence that some species of fish aggregate around turbines during periods with low current speeds, possibly to use the structure for shelter from the flow or for feeding strategies [102]. Other studies have demonstrated avoidance and individual evasion around rotating river turbines and have concluded that collisions are absent or infrequent [103, 104, 105].

Less is known about the risk of collision between tidal turbines and diving seabirds [106]. Nova Innovation have collected 20,000 hours of video data over 5 years from their array in Bluemull Sound, Shetland, and 20 percent of this footage has been examined. Underwater video collected and sampled recorded black guillemot and European shag close to the turbines. All observations were during slack tide or at flow speeds that were too low for turbines to operate. Shags were observed actively pursuing fish around turbines but no physical contact between birds and turbines was observed. The data included less than 30 marine mammal/bird sightings in close proximity to the turbines, and no evidence of collisions [107].

A recent program of research, funded by the Scottish Government, was carried out at MeyGen 1A in the Inner Sound (Pentland Firth) to provide a better understanding of collision risk posed by tidal turbines [101]. The full suite of outputs from this work are not yet published but initial results from the research show that:

- Harbour seals foraged in tidal development sites but spent very little time within 100 m of operating tidal turbines.
- Seals avoided the turbines while they were operating.
- Fine scale tracking of harbour porpoises in the vicinity of the operational turbine revealed evidence of localised evasion; over 451 days of monitoring, no tracks were detected going through the rotor swept area while the turbine was operating with only a single tracked animal passing through the rotor area while the rotors were stationary [101].
- Porpoises frequently swim within 150 m of operational tidal turbines, but occurrence is between 33% - 78% lower during periods of turbine operation, relative to non-operation.
- Dolphins were detected by hydrophones, mostly in winter (which is similar to porpoises), but at a much lower rate.
- Fish schools were at much higher abundances during neap vs spring tides. There is most likely a threshold effect between amount of fish available and the number of foraging seabirds [108].
- Seabirds species will be affected differently by the presence of tidal turbines as pelagic-foraging species detections were found to be related to dynamic fish school locations, whereas benthic-foraging species detections were linked to set locations in the site [108].

It is important to also highlight that whilst the monitoring techniques used to date are designed to detect collisions, none have the capacity to reliably determine whether a collision has occurred. Information on the fine-scale underwater movements (at a scale of metres) of individual animals of a range of species across different taxa (other mammals, birds and fish) around operating turbines remains a critical research gap with respect to understanding the potential impacts of tidal devices.

To conclude, good progress has been made to improve understanding of how marine mammal and fish species respond to operating turbines at a range of spatial scales. There is currently no evidence of collisions between turbines and protected marine animals. In the Pentland Firth, it was shown in §2 that relatively low array density is required to achieve the 6 GW installed capacity necessary to extract its practical resource estimate. In practise, as arrays increase in size, turbines will be distributed non-uniformly, resulting in areas of higher collision risk than others. Monitoring will likely be needed throughout the array expansion process to improve understanding of how collision risk

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60

scales with array size and spatial distribution of turbines. The focus of monitoring will likely require a shift from understanding how individuals behave in the immediate vicinity of single turbines, to how individuals behave between devices in an array.

5.3. *Habitat change and displacement*

Evidence to date suggests that habitat displacement caused by single devices and small arrays is relatively small-scale. For example, studies of harbour seals have demonstrated empirical evidence for displacement of between a few hundred metres [98, 97], to a maximum of 2 km [100]. These represent relatively small-scale responses relative to the scale of movements generally exhibited by these species. There are fewer studies on cetacean species but there is evidence of a local scale reduction in activity at the scale of tens to a few hundred metres around devices [99]. Although apparently relatively minor, the significance of this displacement may depend on the location and the availability of alternative habitat. Seabird data collected from operational wind farms shows that when animals are displaced from historical feeding areas, local abundance levels can be affected significantly [109].

Another potential cause of displacement is the change to the physical environment (i.e. the habitats of foraging mobile animals) in locations of energy extraction and downstream of an array [20]. However, modelling studies indicate that these changes are likely to be relatively small compared to the impacts of climate change and the impacts this will have on how animals are going to change the way they feed [110]. Similarly, the effects of energy extraction on predator-prey relationships are expected to be small relative to the impacts of climate change [80].

Published studies on the effects on benthic habitats and species are relatively rare, possibly reflecting regulatory priorities that often focus on the impacts of protected pelagic species. Additionally, long observation periods are required to detect long-term changes in such habitats, which can be challenging to obtain. In addition to the direct habitat loss that results from the footprint of seabed-mounted devices and from associated cables, benthic habitats can also be altered by local changes in turbulence and the creation of new habitat for colonisation; however these changes have been demonstrated to be very localised [111, 112]). Modelling studies have also predicted that any changes to biomass are likely to occur within the area of developments rather than outside of them [113].

The 2020 State of the Science report [114] concludes that tidal stream turbines may provide habitats for biofouling organisms, whilst also attracting fish and other animals, through the creation of artificial reefs. This has the potential to alter fish populations in surrounding areas. Overall, changes to habitat are likely to pose a low risk to animals, if turbine deployment in fragile or sensitive habitats is avoided. Long-term studies of changes to habitats will be required to understand whether there is the potential for such changes to result in any ecological significance and to validate predictive models.

Noise is produced at all stages of a tidal turbine project, from construction to operation and decommissioning, with the potential to affect the surrounding

ecosystem, from primary producers to top predators. Of the single devices that have been measured to date, the potential for auditory injury and habitat displacement appears to be low for marine mammals and fish [115]. Measurements taken within 100 m of the turbine during low, neap, sea states, show that noise levels are elevated by approximately 30-40 dB as a result of the turbine's noise emissions. This is equivalent to an increase in noise levels of 30-40%, based on ambient noise measurements of 100 dB. The level of turbine noise elevation reduced to 5 dB at a distance of 2.3 km away from the turbine [116]. Ambient noise during spring tides will be considerably higher than that recorded during the experiments. On a small-scale, it has been shown that harbour seals avoid simulated tidal turbine sounds [98] and harbour porpoise click activity was significantly reduced compared to baseline levels, within a few hundred metres of an active device [99].

Based on these findings, it is concluded that the risk of habitat displacement from single devices/small arrays is relatively low. Continued monitoring of animals at operational tidal stream energy projects is required to establish the impacts of larger arrays as they scale up. Methods of measurement must adhere to those set out in technical standards, such as the International Electrochemical Commission technical standard 62600-40:2019 - Part 40, which is becoming the accepted means of measuring acoustic output from tidal turbines [117].

6. Conclusions and recommendations for future research

To achieve net-zero targets, a diverse fleet of cost-effective renewable power generation technologies are needed. The latest tidal stream practical resource estimate, of 34 TWh/year is equivalent to 11% of the UK's current annual electricity demand. Evidence has been provided that helps validate the estimate, both in terms of the method used to estimate energy extraction, and the economic and environmental constraints implemented that cap the resource to practically achievable levels.

We estimate that for 34 TWh/year to be achieved, approximately 11.5 GW of installed capacity is required, with 6 GW in the Pentland Firth, Scotland, and 2 GW in the Channel Islands. Significant grid reinforcements would be required in the two regions to transmit power to high demand centres. Sites located on the south coast of England, and in the Bristol Channel, have relatively good access to local grid infrastructure, thus helping to limit whole-system costs.

We show that the LCoE of tidal stream is on a steep downward trajectory relative to other technologies. LCOE is intrinsically linked to cumulative installed capacity, with future installations reliant on government subsidy. In the UK, three projects are eligible to bid for CfD subsidy support in AR4 under current rules (Morlais; 14 MW, PTEC 30 MW and MeyGen 1C; 80 MW). We estimate that the build out of all three projects can reduce LCoE from its current level, of approximately 240 £/MWh, to less than 150 £/MWh, making tidal stream cost competitive with technologies such as combined cycle gas turbines, biomass and anaerobic digestion. This projection is based on a technology learning rate of 17%, informed by future array costs, which is conservative relative to the 25%

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60

technology learning rate achieved by operational projects to date. In recent years the rate of installed capacity increase in the UK has slowed, due to the lack of subsidy support. Installing 124 MW at MeyGen 1C, PTEC and Morlais by 2013 would put the tidal stream industry back on a trajectory to install its 11.5 GW potential by 2050.

It has recently been announced that in AR4, tidal stream will compete for subsidy support in pot 2 against technologies such as remote island wind, and floating offshore wind. The majority of the pot 2 technologies have a significantly lower administrative strike price than tidal stream. This makes it unlikely that tidal stream will be able to secure subsidy support, unless a ring-fence is provided to give subsidy access that is uncontested by other technologies, similar to the one being provided for floating offshore wind.

The cyclic, predictable nature of tidal stream power generation has been shown to deliver whole-system cost savings that can improve its cost competitiveness relative to other variable generation technologies. We identify this to be a key area for further research, given that cyclic and predictable power generation are two widely assumed benefits of tidal stream, that are only supported through initial estimates of whole-system cost savings. This is particularly pertinent given that the penetration of variable power sources onto the grid is increasing, providing significant grid integration challenges, such as supply-demand balancing.

We find no evidence that tidal stream turbines have caused detrimental environmental impacts to date. Environmental monitoring of single/small arrays of turbines has improved understanding of collision risk between turbines and animals. Similarly, evidence shows that single devices and small arrays have relatively small-scale impacts on sediment distribution and habitat displacement. It is important to contextualise environmental impacts, where for example, changes to stratification, and predator-prey interaction, caused by tidal stream development, are projected to be an order of magnitude less than those from climate change. Ongoing field measurements are required to establish the impacts of array scale on environmental impacts as the industry develops, since in many areas modelling is not yet capable of providing the necessary accuracy required.

To conclude, the evidence presented in this review broadly supports the latest UK practical resource estimate, of 34 TWh/year. To reduce uncertainty in the estimate further, we recommend that an updated national scale practical resource study is conducted, that implements (a) improved fidelity, site-specific hydrodynamic modelling, (b) enhanced model validation, that utilises all relevant field measurements taken at each site, (c) sensitivity analysis to investigate the impacts of economic, environmental, regulatory and social constraints on the practical resource, and (d) quantification of whole-system costs and eLCoE, relative to competing technologies.

Funding

D.Coles, J.Miles, P.Thies and S.Walker acknowledge the financial support of the Tidal Stream Industry Energiser project (TIGER), which is co-financed by the European Regional Development Fund through the Interreg France (Channel) England Programme. A.Angeloudis acknowledges the support of NERC through the Industrial Innovation fellowship grant NE/R013209/2. D.Greaves, B.Scott, T.Stallard, D.White, R.Willden and B.Williamson acknowledge EP-SRC for supporting part of this work through EP/S000747/1. G.Hastie and C.Sparling acknowledge support by the Scottish Government funded Marine Mammal Scientific Support Programme MMSS/002 with additional resources from the Natural Environment Research Council grants NE/R014639/1 and NE/R015007/1. M.Lewis acknowledges the support of the Smart Efficient Energy Centre (SEEC) at Bangor University, part-funded by the European Regional Development Fund (ERDF), administered by the Welsh Government, and the EPSRC METRIC fellowship (EP/R034664/1). L.Mackie acknowledges the financial support of an EPSRC PhD studentship award, grant number EP/R513052/1(18-22). J.McNaughton acknowledges the financial support of R.Willden's EPSRC Advanced Fellowship EP/R007322/1. S.Neill acknowledges the support of SEEC (Smart Efficient Energy Centre) at Bangor University, part-funded by the European Regional Development Fund (ERDF), administered by the Welsh Government.

Acknowledgements

Thanks to Andy Baldock, Sue Barr, Kerry Hayes, Mohammed Irfan, Miriam Noonan, Tim Warham, and Teo van der Kammen, who all provided useful feedback that helped form this work. Thanks also to the reviewers and editor for their constructive feedback.

Appendix A. Cost-reduction mechanisms

Appendix A.1. Economies of scale

Economies of scale relate to the size/specification of infrastructure installed on a project. When applied to the turbines themselves, this can result in significant increases in energy production per turbine, thereby reducing the number of turbine installations required to meet a given array capacity, leading to a reduction in the number of installation, maintenance and decommissioning operations, as well as minimising other infrastructure costs such as cabling [19]. Any cost benefit from economies of scale must exceed any additional cost incurred from increased turbine loading, for example [118]. The diameter of the Orbital Marine Power rotors has increased from 16 m on the SR2000, to 20 m on their next iteration, the O2. This has also led to a reduction in hub height of approximately 2 m. Since the Orbital device is a dual-rotor machine, the increased diameter of the rotors increased the total swept area of the device

by 56%. At below rated power, power generation is directly proportional to swept area, so similar levels of power generation increase are expected. A new tidal stream turbine cost model has been developed that estimates that this increase in rotor diameter is achievable with an increase in turbine CapEx of 41% [119]. This demonstrates that the uplift in energy yield from increases in turbine scale can outweigh the additional CapEx incurred, and that significant increases in turbine scale are achievable within the time-frame of LCoE projections presented in §3.

Table A.3 summarises economies of turbine scale and their impact on energy yield. Combining these economies of scale can result in significant increases in annual energy yield per turbine. For example, a 3 MW, 24 m turbine with 17 m hub height can produce nearly double the annual energy of a 1.5 MW, 18 m turbine with 14 m hub height [120].

Table A.3: Summary of economies of scale.

Mechanism	Description
Rotor diameter	There has been a gradual increase in rotor diameter from c. 5 m in 1990 to 20 m on current turbines. Increases in power generation scale approximately with the rotor radius squared. It is estimated that increasing the rotor diameter of the current MeyGen Phase 1A turbines from 18 m to 24 m would increase energy yield by 34% [120].
Rated power	The rated power of turbines has increased from c. 15 kW in the 1990's to 2 MW on devices deployed in 2021. It is estimated that increasing the rated power of a 24 m rotor diameter turbine at MeyGen from 1.5 MW to 2 MW increases annual energy yield per turbine by 17% [120].
Hub height	Based on the typical vertical boundary layer profiles at tidal stream energy sites, approximately 75% of the energy is in the upper 50% of the water column. Floating devices position their rotors in this higher-energy region of the water column, enabling energy yield to be maximised for a given location. It is estimated that energy yield increases by approximately 2% per metre increase in hub height [120].

Appendix A.2. Economies of volume

Experience from the offshore wind industry suggests that as the number of turbines within arrays increases, common components become standardised, enabling production costs per unit to be reduced through mass manufacturing [4]. Lessons from the MeyGen 1A project highlight that the four turbine array is not enough to drive unit cost-reductions because dedicated production facilities and tooling could not be justified, but that larger turbine volumes are expected to bring these economies of volume in the future [19]. Increasing turbine volume allows some costs to be shared across turbines. For example, a significant cost related to the installation of large turbines is the mobilisation and de-mobilisation of dynamic positioning vessels, where the vessel is loaded with all necessary equipment and infrastructure, and unloaded after use. The cost of mobilisation/de-mobilisation costs per turbine reduce as the number of turbines to be installed increases. It has been estimated that a 36 turbine array

875 reduces mobilisation and de-mobilisation days per turbine by 26% relative to a
four turbine array, with a similar level of vessel cost saving expected [120].

Appendix A.3. Technology Innovation

Table A.4 summarises examples of technology development that show promise
to drive down costs.

For Review Only

Table A.4: Summary of technology innovations

Mechanism	Description
Sub-sea hub	Sub-sea hubs provide a central point to join multiple turbines to a single export cable. The sub-sea hub reduces the number of export cables and onshore power converters, whilst also reducing cable installation time per turbine. There is an estimated 80% saving in the total cost of the associated infrastructure (i.e. cables, converters etc.) as a result of using sub-sea hubs [120].
Cable design	Cable incidents cause 85% of the insurance claims related to offshore wind. For fixed tidal stream systems, cables are estimated to represent 14% of total CapEx. Recent research demonstrates that rocky seabeds have a wide fluid boundary layer and high seabed friction, due to the ruggedness. The observed stability of the power export cables used on the MeyGen 1A tidal stream project, which could not be certified as stable using the conventional design approach, supports this research [121, 122]. By redesigning cables accordingly, cost-reductions will emerge.
Wet-mate connectors	The connection between the export cable and the turbine is made using either dry-mate or wet-mate connectors. Dry-mate connectors must make the cable-turbine connection out of the water, which is done during turbine installation/retrieval by lifting the export cable from the seabed to the deck of the vessel. Wet-mate connectors allow the turbine-cable connection to be made sub-sea, allowing the export cable to remain on the seabed. By avoiding the need to manipulate the export cable, wet-mate connectors simplify offshore operations, reducing the time needed to carry out a turbine installation/retrieval, thereby reducing the overall installation cost by around 65% relative to turbines using dry-mate connectors. Wet-mate connectors also de-risk cable damage by reducing the number of times the cable is moved over its life [19].
Foundations	Seabed mounted tidal stream turbines use heavy gravity-base foundations (GBF) to maintain stability. The cost of GBFs is between 11% of the CapEx [118, 19]. It is estimated that the adoption of monopile foundations can reduce the amount of steel used per foundation by 90%, which can lead to cost saving. Alternative emergent technologies such as remotely-operated micro-pile installation rigs, as well as the potential to unlock higher seabed friction for a conventional gravity base, in the same way as has been done for cable stability, also offer the potential for cost-reductions.
Floating systems	Floating turbines can reduce OpEx costs significantly by widening access windows and removing reliance on dynamic positioning vessels to carry out offshore operations. Devices can instead be recovered to port or calmer waters for maintenance activities. Floating devices also allow deeper water sites to be developed. OpEx is estimated to account for 17% of total project costs for floating devices, compared to 43% for seabed-mounted devices [118]. 2012 OpEx estimates by Orbital Marine Energy (formerly Scotrenewables) for a prospective floating array using 5 x 2 MW devices range between 0.16 – 0.24 £m/MW/year (excluding decommissioning), with an expectation for OpEx to rapidly reduce to below 0.1 £m/MW/year on subsequent projects [123]. For comparison, the OpEx of the MeyGen 1A seabed mounted turbines is 0.23 £m/MW/year.
Multi-rotor systems	Multi-rotor systems provide constructive interference between rotors, with experimental data showing a 20% power performance increase with a 10% thrust increase due to this local blockage [124]. Initial LCoE estimates show that this can result in a c. 10% cost of energy reduction.
Array optimisation	Gradient-based algorithms have been implemented within 2D hydrodynamic models to optimise the number of turbines and their position within an array [39, 40, 41]. Results demonstrate that mean turbine power can increase by up to 30% relative to a regular array layout, thereby significantly reducing LCoE.

880 *Appendix A.4. Learning*

885 The experience gained from all aspects of a project can lead to significant cost savings through better understanding of processes and design [4]. The learning from MeyGen Phase 1A has been captured in three reports covering the design, installation and operating phases of the project [125, 126, 19]. Whilst there are too many lessons to list all of them here, we summarise some of the most significant ones in Table A.5. These examples of learning, along with the other cost reduction drivers demonstrated in this appendix all contribute to the ‘technology learning rate’, that is discussed and implemented in §3 to provide LCoE projections.

Table A.5: Summary of learning from MeyGen Phase 1A.

Mechanism	Description
Turbine design	MeyGen Phase 1A used two different turbine suppliers. Whilst it has been acknowledged that this increased overall cost relative to using a single turbine supplier, it allowed the two suppliers to learn from one another through comparison of different techniques and equipment to steepen the learning curve. An improved understanding of site conditions such as turbulence was gained through multiple ADCP measurement campaigns, leading to an improved understanding of turbine loading to inform future turbine design. This is complemented by recent research that characterises turbine loading [127, 128, 129].
Offshore operations	During offshore operations MeyGen gained an improved understanding of the ability of different vessels to undertake specific tasks, informing future decision making on vessel selection to de-risk operations. It was also found that in some cases, two marine operations could be performed in a single neap tide period, reducing vessel time and cost.
Turbine micro-siting	It proved challenging to find suitably flat regions of the site to micro-site the turbines using gravity based foundations and support structure, highlighting the value of monopile structures for future development, which de-risk offshore operations and enable turbines to be positioned in higher-energy regions of a site.
Power performance	Learning from power performance analysis of the MeyGen array shows that the turbines are operating with a power coefficient of 0.41, 8% higher than their target power coefficient of 0.38. This learning can be used to inform projected energy yield estimates for future phased development.

890 *Appendix A.5. Financing*

895 The CapEx of tidal stream energy projects is relatively high, typically requiring finance from a combination of grant funding, debt and equity. Attracting finance requires high levels of investor confidence. Given the relative infancy of the industry, and therefore high risk, this can be hard to achieve. Projects using more established technologies such as onshore/fixed-bed offshore wind or solar PV offer lower-risk investments, since years of operational experience allows risks to be more accurately quantified and mitigated against. In recent years, tidal stream energy projects have become operational. Detailed array

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60

performance is now being reported publicly on projects such as MeyGen 1A [19]. To date, the tidal stream energy industry has accumulated approximately 1.4 million operating hours. During this time, there has been a reduction in empirical failure rate, and likelihood of failure similar to that experienced by the wind industry at a similar stage [10]. Through the ongoing demonstration of operational arrays, and investor confidence, the cost of capital is expected to reduce. However, of the operational projects to date, only the MeyGen project has publicised power performance and cost data. So whilst operational data are being gathered, there is poor visibility over how operational assets are performing. The ongoing demonstration and performance reporting of operational projects is expected to reduce cost of capital as investor confidence in the technology increases.

The increase in operational hours can also increase the range of insurance products for tidal stream energy. Through increased operational experience gained by site operators, insurance claims become better understood, which can lead to a reduction in premiums. Technology innovations such as sub-sea hubs and wet-mate connectors reduce the need for cable lifting operations, reducing risk of cable failure, which account for the highest cable failures in fixed-bed offshore wind accounted for 77% of the total global cost of fixed-bed offshore wind farm losses in 2015 [118].

References

[1] BEIS, Historical electricity data: 1920 to 2019, Technical Report, 2019.

[2] National Statistics, 2019 UK greenhouse gas emissions, provisional figures, Technical Report, 2020.

[3] Climate Change Committee, The Sixth Carbon Budget: The UK’s path to Net Zero, Technical Report December, 2020. URL: <https://www.theccc.org.uk/publication/sixth-carbon-budget/>.

[4] Offshore Renewable Energy Catapult, Tidal stream and wave energy cost reduction and industrial benefit, Technical Report, 2018.

[5] BVG Associates, UK offshore wind history, 2019. URL: <https://guidetoanoffshorewindfarm.com/offshore-wind-history>.

[6] Ofgem, Guidance for generators that receive or would like to receive support under the Renewables Obligation (RO) scheme, Technical Report, 2019.

[7] BEIS, Contracts for Difference Allocation Round One Outcome, Technical Report, 2015.

[8] BEIS, Contracts for Difference Second Allocation Round Results, Technical Report, 2017.

- [9] BEIS, Contracts for Difference Allocation Round 3 Results, Technical Report, 2019.
- [10] S. Walker, P. Thies, A review of component and system reliability in tidal turbine deployments, Renewable and Sustainable Energy Reviews 151 (2021) 111495.
- [11] J. Colby, Marine and Hydrokinetic energy: establishing an industry standard, 2021.
- [12] Department for Business Energy and Industrial Strategy, Marine energy: A call for evidence on the potential of marine energy projects in Great Britain, Technical Report August, 2020.
- [13] UK Parliament Committees, Technology Innovations and Climate Change: Tidal power, Inquiry, 2020.
- [14] P. Dunne, Technological Innovations and Climate Change inquiry: tidal power, 2021.
- [15] BEIS, Contracts for Difference (CfD): Draft Budget Notice for the fourth allocation round, 2021.
- [16] The Carbon Trust, UK Tidal Current Resource and Economics, Technical Report, 2011.
- [17] National Academy, An evaluation of the U.S. Department of Energy's marine and hydrokinetic resource assessments, Technical Report, 2013.
- [18] S. Couch, Numerical modelling of tidal flows around headlands and islands, Ph.D. thesis, University of Strathclyde, 2001.
- [19] Black and Veatch, Lessons Learnt from MeyGen Phase 1A Final Summary Report, Technical Report, 2020.
- [20] M. De Dominicis, J. Wolf, R. O'Hara Murray, Comparative Effects of Climate Change and Tidal Stream Energy Extraction in a Shelf Sea, Journal of Geophysical Research: Oceans 123 (2018) 5041–5067.
- [21] European Marine Energy Centre Ltd, Assessment of tidal energy resource, Technical Report, 2009.
- [22] C. Garrett, P. Cummins, The power potential of tidal currents in channels, Proceedings of the Royal Society A: Mathematical, Physical and Engineering Sciences 461 (2005).
- [23] P. E. Robins, S. P. Neill, M. J. Lewis, S. L. Ward, Characterising the spatial and temporal variability of the tidal-stream energy resource over the northwest European shelf seas, Applied Energy 147 (2015) 510–522.

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60

[24] S. P. Neill, A. Vögler, A. J. Goward-Brown, S. Baston, M. J. Lewis, P. A. Gillibrand, S. Waldman, D. K. Woolf, The wave and tidal resource of Scotland, *Renewable Energy* 114 (2017) 3–17.

975 [25] S. Draper, Tidal stream energy extraction in coastal basins, Ph.D. thesis, University of Oxford, 2011.

[26] Carbon Trust, UK Tidal Current Resource and Economics: Appendix C, Technical Report, 2011.

980 [27] D. Coles, L. Blunden, A. Bahaj, Assessment of the energy extraction potential at tidal sites around the Channel Islands., *Energy* 124 (2017) 171–186.

985 [28] D. S. Coles, L. S. Blunden, A. S. Bahaj, The energy yield potential of a large tidal stream turbine array in the Alderney Race: Energy yield estimate for Alderney Race, *Philosophical Transactions of the Royal Society A: Mathematical, Physical and Engineering Sciences* 378: 20190 (2020).

[29] D. Haverson, J. Bacon, H. C. Smith, V. Venugopal, Q. Xiao, Modelling the hydrodynamic and morphological impacts of a tidal stream development in Ramsey Sound, *Renewable Energy* 126 (2018) 876–887.

990 [30] A. Bahaj, J. Molland, J. Chaplin, W. Batten, Power and thrust measurements of marine current turbines under various hydrodynamic flow conditions in a cavitation tunnel and a towing tank, *Renewable Energy* 32 (2007) 407–426.

995 [31] S. Rasheed, S. C. Warder, Y. Plancherel, M. D. Piggott, An Improved Gridded Bathymetric Data Set and Tidal Model for the Maldives Archipelago, *Earth and Space Science* 8, e2020EA (2021).

[32] L. Mackie, P. S. Evans, M. J. Harrold, T. O’Doherty, M. D. Piggott, A. Angeloudis, Modelling an energetic tidal strait: investigating implications of common numerical configuration choices, *Applied Ocean Research* 108 (2021).

1000 [33] R. O’Hara Murray, A. Gallego, A modelling study of the tidal stream resource of the Pentland Firth, Scotland, *Renewable Energy* 102 (2017) 326–340.

1005 [34] A. C. W. Creech, A three-dimensional numerical model of a horizontal axis, energy extracting turbine, Ph.D. thesis, Heriot-Watt University, 2009.

[35] M. A. Abolghasemi, M. D. Piggott, J. Spinneken, A. Viré, C. J. Cotter, S. Crammond, Simulating tidal turbines with multi-scale mesh optimisation techniques, *Journal of Fluids and Structures* 66 (2016) 69–90.

- [36] M. Grondeau, J. C. Poirier, S. Guillou, Y. Méar, P. Mercier, E. Poizot, Modelling the wake of a tidal turbine with upstream turbulence: LBM-LES versus navier-stokes LES, *International Marine Energy Journal* (2020) 83–89.
- [37] T. A. Adcock, S. Draper, G. T. Houlsby, A. G. Borthwick, S. Serhadlioglu, The available power from tidal stream turbines in the Pentland Firth, *Proceedings of the Royal Society A: Mathematical, Physical and Engineering Sciences* 469 (2013).
- [38] A. Bahaj, L. Myers, Analytical estimates of the energy yield potential from the Alderney Race (Channel Islands) using marine current energy converters, *Renewable Energy* 29 (2004) 1931–1945.
- [39] S. Funke, P. Farrell, M. Piggott, Tidal turbine array optimisation using the adjoint approach, *Renewable Energy* 63 (2014) 658–673.
- [40] S. Funke, S. Kramer, M. Piggott, Design optimisation and resource assessment for tidal-stream renewable energy farms using a new continuous turbine approach, *Renewable Energy* 99 (2016) 1046–1061.
- [41] D. M. Culley, S. W. Funke, S. C. Kramer, M. D. Piggott, A surrogate-model assisted approach for optimising the size of tidal turbine arrays, *International Journal of Marine Energy* 19 (2017) 357–373.
- [42] Z. L. Goss, D. S. Coles, M. D. Piggott, Identifying economically viable tidal sites within the Alderney Race through optimization of levelized cost of energy: Economic viability of the Alderney Race, *Philosophical Transactions of the Royal Society A: Mathematical, Physical and Engineering Sciences* 378: 20190 (2020).
- [43] International Electrotechnical Commission, Marine energy - Wave, tidal and other water current converters - Part 201: Tidal energy resource assessment and characterisation, Technical Report, 2011.
- [44] BEIS, Electricity Generation Costs 2020, Technical Report, 2020.
- [45] I. Tsiropoulos, D. Tarvydas, A. Zucker, Cost development of low carbon energy technologies - Scenario-based cost trajectories to 2050, 2017 edition, Technical Report, European Commission, 2018. doi:10.2760/23266.
- [46] Carbon Trust, Future Marine Energy. Results of the Marine Energy Challenge: Cost competitiveness and growth of wave and tidal stream energy, Technical Report, 2006.
- [47] Ernst Young, Cost of and financial support for wave, tidal stream and tidal range generation in the UK: A report for the Department of Energy and Climate Change and the Scottish Government, Technical Report, 2010.

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60

[48] Arup, Department of Energy and Climate Change Review of the generation costs and deployment potential of renewable electricity technologies in the UK Study Report, Technical Report Job number 215030, 2011.

1050 [49] Arup, Review of Renewable Electricity Generation Cost and Technical Assumptions. Study Report, Technical Report, Department of Energy and Climate Change, 2016.

1055 [50] IRENA, International Renewable Energy Agency. Renewable Power Generation Costs in 2017, 2018. URL: <https://www.irena.org/publications/2018/Jan/Renewable-power-generation-costs-in-2017>.

[51] BVG Associates, Wind farm costs, 2018. URL: <https://guidetoanoffshorewindfarm.com/privacy>.

1060 [52] HM Government, Industrial strategy-Offshore wind sector deal, Technical Report, 2019.

[53] S. Bhattacharya, S. Pennock, B. Robertson, S. Hanif, M. J. E. Alam, D. Bhatnagar, D. Prezioso, R. O'Neil, Timing value of marine renewable energy resources for potential grid applications, Applied Energy 299 (2021) 117281.

1065 [54] D. Coles, A. Angeloudis, Z. Goss, J. Miles, Tidal stream vs. wind energy: the value of predictable, cyclic power generation in off-grid hybrid systems, Energies (2021).

[55] D. Pugh, Tides, Surges and Mean Sea-Level, John Wiley Sons, 1996.

1070 [56] D. Partington, Intermittency of UK Wind Power Generation 2013 and 2014, Technical Report April, 2015.

[57] C. Aris, Wind Power Reassessed : A review of the UK wind resource for electricity generation, Technical Report, Adam Smith Institute, 2014.

1075 [58] BEIS, New plans to make UK world leader in green energy, 2020. URL: <https://www.gov.uk/government/news/new-plans-to-make-uk-world-leader-in-green-energy>.

[59] M. Foreman, R. Henry, The harmonic analysis of tidal model time series, Advances in Water Resources 12 (1989).

1080 [60] R. Pawlowicz, R. Pawlowicz, R. C. Beardsley, R. Beardsley, S. Lentz, S. Lentz, Classical tidal harmonic analysis including error estimates, in MATLAB using T TIDE. Computers Geosciences 28 (2002) 929–937.

[61] BEIS, Energy White Paper. Powering our Net Zero Future, Technical Report, 2020.

- [62] International Energy Agency, The Power of Transformation. Wind, Sun and the Economics of Flexible Power Systems, IEA, 2014.
- 1085 [63] Frontier Economics, Whole power system impacts of electricity generation technologies, Technical Report, 2016.
- [64] J. P. Barton, D. G. Infield, Energy storage and its use with intermittent renewable energy, IEEE Transactions on Energy Conversion 19 (2004) 441–448.
- 1090 [65] G. N. Bathurst, G. Strbac, Value of combining energy storage and wind in short-term energy and balancing markets, Electric Power Systems Research 67 (2003) 1–8.
- [66] P. Coker, J. Barlow, T. Cockerill, D. Shipworth, Measuring significant variability characteristics: An assessment of three UK renewables, Renewable Energy 53 (2013) 111–120.
- 1095 [67] R. Hemmati, H. Saboori, Emergence of hybrid energy storage systems in renewable energy and transport applications – A review, Renewable and Sustainable Energy Reviews 65 (2016) 11–23.
- [68] Agora Energiewende, The Integration Costs of Wind and Solar Power: An Overview of the Debate on the Effects of Adding Wind and Solar Photovoltaic into Power Systems, Technical Report, 2016.
- 1100 [69] National Grid, Future Energy Scenarios, Technical Report, 2019.
- [70] Metoc, Tidal power in the UK. Research Report 1 - UK tidal resource assessment, Technical Report, 2007.
- 1105 [71] I. G. Bryden, D. M. Macfarlane, The utilisation of short term energy storage with tidal current generation systems, Energy 25 (2000) 893–907.
- [72] J. A. Clarke, G. Connor, A. D. Grant, C. M. Johnstone, Regulating the output characteristics of tidal current power stations to facilitate better base load matching over the lunar cycle, Renewable Energy 31 (2006) 173–180.
- 1110 [73] E. Barbour, I. G. Bryden, Energy storage in association with tidal current generation systems, Proceedings of the Institution of Mechanical Engineers, Part A: Journal of Power and Energy 225 (2011) 443–455.
- [74] S. Manchester, B. Barzegar, L. Swan, D. Groulx, Energy storage requirements for in-stream tidal generation on a limited capacity electricity grid, Energy 61 (2013) 283–290.
- 1115 [75] Nova Innovation, A World-First for Nova Innovation: the ‘Holy Grail’ of Baseload Tidal Power, 2018. URL: <https://www.novainnovation.com/post/a-world-first-for-nova-innovation-the-holy-grail-of-baseload-tidal-power>.
- 1120

[76] European Marine Energy Centre, Press release: world's first tidal-powered hydrogen generated at EMEC, 2020. URL: [http://www.emec.org.uk/press-release-worlds-first-tidal-powered-hydrogen-generated-at-emec/#:\\\$sim\\$:text=TheEuropeanMarineEnergyCentre,onFriday25thAugust2017](http://www.emec.org.uk/press-release-worlds-first-tidal-powered-hydrogen-generated-at-emec/#:\sim:text=TheEuropeanMarineEnergyCentre,onFriday25thAugust2017).
1125

[77] European Marine Energy Centre, Press release: World's first tidal-powered hydrogen generated at EMEC, 2017. URL: <http://www.emec.org.uk/press-release-worlds-first-tidal-powered-hydrogen-generated-at-emec/>.
1130

[78] Redpoint Energy Ltd, The benefits of marine technologies within a diversified renewables mix. A report for the British Wind Energy Association, Technical Report, 2009.

[79] R. Gross, T. Green, M. Leach, J. Skea, P. Heptonstall, D. Anderson, The Costs and Impacts of Intermittency: An assessment of the evidence on the costs and impacts of intermittent generation on the British electricity network, Technical Report, UK Energy Research Centre, 2006.
1135

[80] EcoWatt Project, EcoWatt 2050. Project Summary 2017, Technical Report, 2017.

[81] S. Neill, M. Hashemi, Fundamentals of Ocean Renewable Energy Generating electricity from the sea, Academic Press, 2018.
1140

[82] M. C. Easton, A. Harendza, D. K. Woolf, A. C. Jackson, Characterisation of a Tidal Energy Site : Hydrodynamics and Seabed Structure, in: EProceedinngs of the 9th European Wave and Tidal Energy Conference, Southampton, UK, 2011.

[83] MeyGen Ltd, MeyGen Tidal Energy Project Phase 1: Environmental Statement, Technical Report, 2012.
1145

[84] S. Neill, J. Jordan, S. Couch, Impact of tidal energy converter (TEC) arrays on the dynamics of headland sand banks, Renewable Energy 37 (2012) 3873–97.

[85] L. Blunden, S. Haynes, A. Bahaj, Tidal current power effects on nearby sandbanks: a case study in the Race of Alderney, Philosophical Transactions of the Royal Society A: Mathematical, Physical and Engineering Sciences 378: 20190 (2020).
1150

[86] A. C. Bastos, N. H. Kenyon, M. Collins, Sedimentary processes, bedforms and facies, associated with a coastal headland: Portland Bill, Southern UK, Marine Geology 187 (2002) 235–258.
1155

[87] I. Fairley, I. Masters, H. Karunaratna, The cumulative impact of tidal stream turbine arrays on sediment transport in the Pentland Firth, Renewable Energy 80 (2015) 755–769.

- 1160 [88] P. E. Robins, S. P. Neill, M. J. Lewis, Impact of tidal-stream arrays in
relation to the natural variability of sedimentary processes, *Renewable
Energy* 72 (2014) 311–321.
- [89] R. Martin-Short, J. Hill, S. C. Kramer, A. Avdis, P. A. Allison, M. D.
Piggott, Tidal resource extraction in the Pentland Firth, UK: Potential
1165 impacts on flow regime and sediment transport in the Inner Sound of
Stroma, *Renewable Energy* 76 (2015) 596–607.
- [90] R. Ahmadian, R. A. Falconer, Assessment of array shape of tidal stream
turbines on hydro-environmental impacts and power output, *Renewable
Energy* 44 (2012) 318–327.
- 1170 [91] R. Ahmadian, R. Falconer, B. Bockelmann-Evans, Far-field modelling
of the hydro-environmental impact of tidal stream turbines, *Renewable
Energy* 38 (2012) 107–116.
- [92] S. Nash, A. Phoenix, A review of the current understanding of the hydro-
environmental impacts of energy removal by tidal turbines, *Renewable
1175 and Sustainable Energy Reviews* 80 (2017) 648–662.
- [93] J. J. Waggitt, B. E. Scott, Using a spatial overlap approach to estimate the
risk of collisions between deep diving seabirds and tidal stream turbines:
A review of potential methods and approaches, *Marine Policy* 44 (2014)
90–97.
- 1180 [94] T. A. Whitton, S. E. Jackson, J. G. Hiddink, B. Scoulding, D. Bowers,
B. Powell, T. D'Urban Jackson, L. Gimenez, A. G. Davies, Vertical migra-
tions of fish schools determine overlap with a mobile tidal stream marine
renewable energy device, *Journal of Applied Ecology* 57 (2020) 729–741.
- [95] H. Viehman, G. Zydlewski, Fish Interactions with a Commercial-Scale
1185 Tidal Energy Device in the Natural Environment, *Estuaries and Coasts*
38 (2015) 241–252.
- [96] C. Sparling, M. Lonergan, B. McConnell, Harbour seals (*Phoca vitulina*)
around an operational tidal turbine in Strangford Narrows: No barrier ef-
fect but small changes in transit behaviour, *Aquatic Conservation: Marine
1190 and Freshwater Ecosystems* 28 (2018) 194–204.
- [97] R. Joy, J. D. Wood, C. E. Sparling, D. J. Tollit, A. E. Copping, B. J.
McConnell, Empirical measures of harbor seal behavior and avoidance of
an operational tidal turbine, *Marine Pollution Bulletin* 136 (2018) 92–106.
- [98] G. D. Hastie, D. J. Russell, P. Lepper, J. Elliott, B. Wilson, S. Benjamins,
1195 D. Thompson, Harbour seals avoid tidal turbine noise: Implications for
collision risk, *Journal of Applied Ecology* 55 (2018) 684–693.

[99] D. Tollit, R. Joy, J. Wood, A. M. Redden, C. Booth, T. Boucher, P. Porskamp, M. Oldreive, Baseline presence of and effects of tidal turbine installation and operations on harbour porpoise in minas passage, Bay of Fundy, Canada, *The Journal of Ocean Technology* 14 (2019) 22–48.

[100] J. Onoufriou, Harbour seals in a tidal stream environment: movement ecology and the effects of a renewable energy installation, Ph.D. thesis, University of St. Andrews, 2020.

[101] D. Gillespie, L. Palmer, J. Macaulay, C. Sparling, G. Hastie, Harbour porpoises exhibit localized evasion of a tidal turbine, *Aquatic Conservation: Marine and Freshwater Ecosystems* (2021) 1–10.

[102] M. Broadhurst, S. Barr, C. D. L. Orme, In-situ ecological interactions with a deployed tidal energy device; an observational pilot study, *Ocean and Coastal Management* 99 (2014) 31–38.

[103] M. Bevelhimer, C. Scherelis, J. Colby, M. A. Adonizio, Hydroacoustic assessment of behavioral responses by fish passing near an operating tidal turbine in the east river, New York, *Transactions of the American Fisheries Society* 146 (2017) 1028–1042.

[104] M. Grippo, G. Zydlewski, H. Shen, R. A. Goodwin, Behavioral responses of fish to a current-based hydrokinetic turbine under multiple operational conditions: Final report, Technical Report, Argonne National Laboratory for U.S. Department of Energy, 2017. doi:10.1007/s10661-020-08596-5.

[105] S. Matzner, C. Trostle, G. Staines, R. Hull, Avila A, G. E. L. Harker-Klimes, Triton: Igiugig Fish Video Analysis. Project Report, Technical Report, Pacific Northwest National Laboratory, 2017.

[106] N. Isaksson, E. A. Masden, B. J. Williamson, M. M. Costagliola-Ray, J. Slingsby, J. D. Houghton, J. Wilson, Assessing the effects of tidal stream marine renewable energy on seabirds: A conceptual framework, *Marine Pollution Bulletin* 157 (2020).

[107] E. Cooper, J. Brocklehurst, K. Smith, EnFAIT – Enabling Future Arrays in Tidal, Technical Report, Enfait, 2020. URL: <https://www.enfait.eu/>.

[108] A. Couto, B. Williamson, T. Cornulier, P. Fernandes, J. D. Chapman, I. Davies, B. Scott, Tidal streams, fish and seabirds: untangling the linkages between mobile predators, prey and hydrodynamics, *Ecosphere* In review (2021).

[109] B. Mendel, P. Schwemmer, V. Peschko, S. Müller, H. Schwemmer, M. Mercker, S. Garthe, Operational offshore wind farms and associated ship traffic cause profound changes in distribution patterns of Loons (*Gavia* spp.), *Journal of Environmental Management* 231 (2019) 429–438.

- [110] D. Sadykova, B. E. Scott, M. De Dominicis, S. L. Wakelin, J. Wolf, A. Sadykov, Ecological costs of climate change on marine predator–prey population distributions by 2050, *Ecology and Evolution* 10 (2020) 1069–1086.
- 1240 [111] J. O’Carroll, Novel Methods of Benthic Habitat Assessment in designated waterbodies around Ireland, Ph.D. thesis, National University of Ireland Galway, 2017.
- 1245 [112] J. Dannheim, L. Bergström, S. N. Birchenough, R. Brzana, A. R. Boon, J. W. Coolen, J. C. Dauvin, I. De Mesel, J. Derweduwen, A. B. Gill, Z. L. Hutchison, A. C. Jackson, U. Janas, G. Martin, A. Raoux, J. Reubens, L. Rostin, J. Vanaverbeke, T. A. Wilding, D. Wilhelmsson, S. Degraer, Benthic effects of offshore renewables: Identification of knowledge gaps and urgently needed research, *ICES Journal of Marine Science* 77 (2020) 1092–1108.
- 1250 [113] K. A. Alexander, S. A. Meyjes, J. J. Heymans, Spatial ecosystem modelling of marine renewable energy installations: Gauging the utility of Ecospace, *Ecological Modelling* 331 (2016) 115–128.
- 1255 [114] A. E. Copping, N. Sather, L. Hannah, J. Whiting, G. Zydlewski, G. Staines, A. Gill, I. Hutchinson, O. A. T. Simas, J. Bald, C. Sparling, J. Wood, E. Masden, 2020 State of the Science Report, Technical Report, 2020.
- 1260 [115] J. Lossent, M. Lejart, T. Folegot, D. Clorennec, L. Di Iorio, C. Gervaise, Underwater operational noise level emitted by a tidal current turbine and its potential impact on marine fauna, *Marine Pollution Bulletin* 131 (2018) 323–334.
- [116] D. Risch, N. van Geel, D. Gillespie, B. Wilson, Characterisation of underwater operational sound of a tidal stream turbine, *The Journal of the Acoustical Society of America* 147 (2020) 2547–2555.
- 1265 [117] International Electrotechnical Commission, IEC TS 62600-40:2019. Marine energy - Wave, tidal and other water current converters - Part 40: Acoustic characterization of marine energy converters, Technical Report, 2019.
- [118] Vivid Economics, Energy Innovation Needs Assessments : Tidal Stream, Technical Report, 2019.
- 1270 [119] D. S. Coles, L. Mackie, D. White, J. Miles, Cost modelling and design optimisation of tidal stream turbines, in: *Preceedings of the 14th European Wave and Tidal Energy Conference*, Plymouth, 2021.
- 1275 [120] D. S. Coles, T. Walsh, Mechanisms for reducing the cost of tidal stream energy, *13th European Wave and Tidal Energy Conference* (2019) 1836–1–8.

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60

[121] T. Griffiths, D. White, S. Draper, F. Johnson, D. Coles, S. Ingham, C. Lourie, L. Cheng, A. Fogliani, Subsea cable stability on rocky seabeds – back analysis of field observations against recent research predictions, in: Proc. Conf. on Ocean, Offshore Arctic Engineering, Madrid, Spain, 2018.

[122] T. Griffiths, W. D.J, S. Draper, L. Cheng, A. Leighton, A. Fogliani, Lateral resistance of ‘rigid’ pipelines and cables on rocky seabeds, Canadian Geotechnical Journal 56 (2019) 823–839.

[123] Scotrenewables, Technology Update – May 2012, Technical Report, 2012.

[124] J. McNaughton, B. Cao, C. R. Vogel, R. H. J. Willden, Model scale testing of multi-rotor arrays designed to exploit constructive interference effects, in: Proceedings of the 13th European Wave and Tidal Energy Conference, Naples, Italy, 2019.

[125] MeyG, E. Ltd, Lessons Learnt from MeyGen Phase 1a. Part 1/3: Design Phase, Technical Report, 2017.

[126] MeyGen Ltd, Lessons Learnt from MeyGen Phase 1a Part 2/3: Construction Phase, Technical Report, 2018.

[127] U. Ahmed, D. D. Apsley, I. Afgan, T. Stallard, P. K. Stansby, Fluctuating loads on a tidal turbine due to velocity shear and turbulence: Comparison of CFD with field data, Renewable Energy 112 (2017) 235–246.

[128] H. R. Mullings, T. J. Stallard, G. S. Payne, Operational loads on a tidal turbine due to environmental conditions, in: Proceedings of the 27th International Offshore and Polar Engineering Conference, San Francisco, USA, 2017, pp. 222–229.

[129] H. Mullings, T. Stallard, Unsteady loading in a tidal array due to simulated turbulent onset flow, in: 3rd International Conference on Renewable Energies Offshore, Lisbon, Portugal, 2018, pp. 227–235.

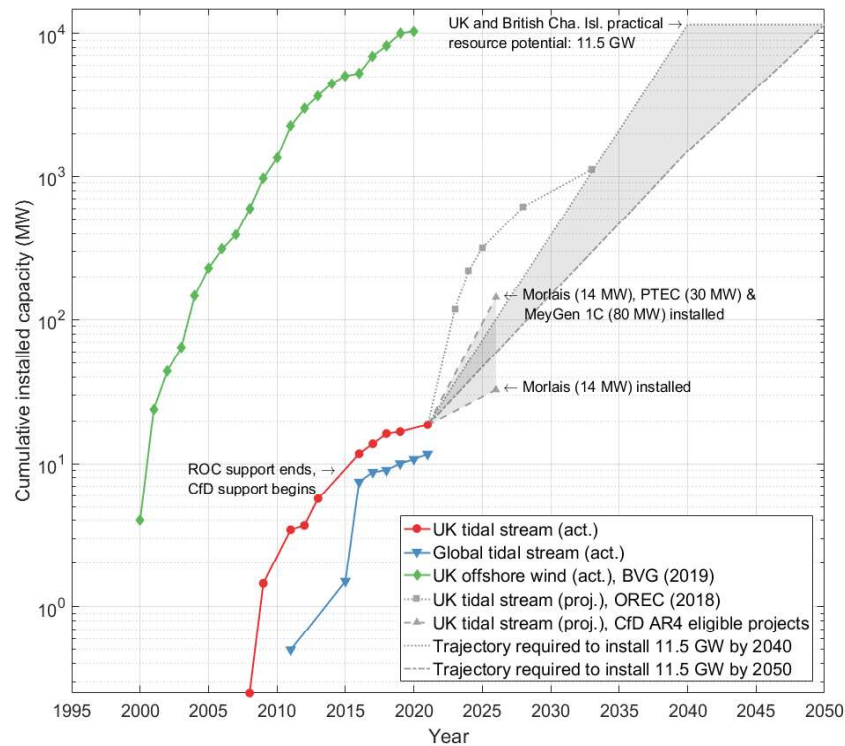


Figure 1: Actual and projected cumulative installed capacity of tidal stream and fixed-bed offshore wind in the UK and globally (excluding the UK).

737x638mm (38 x 38 DPI)

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60

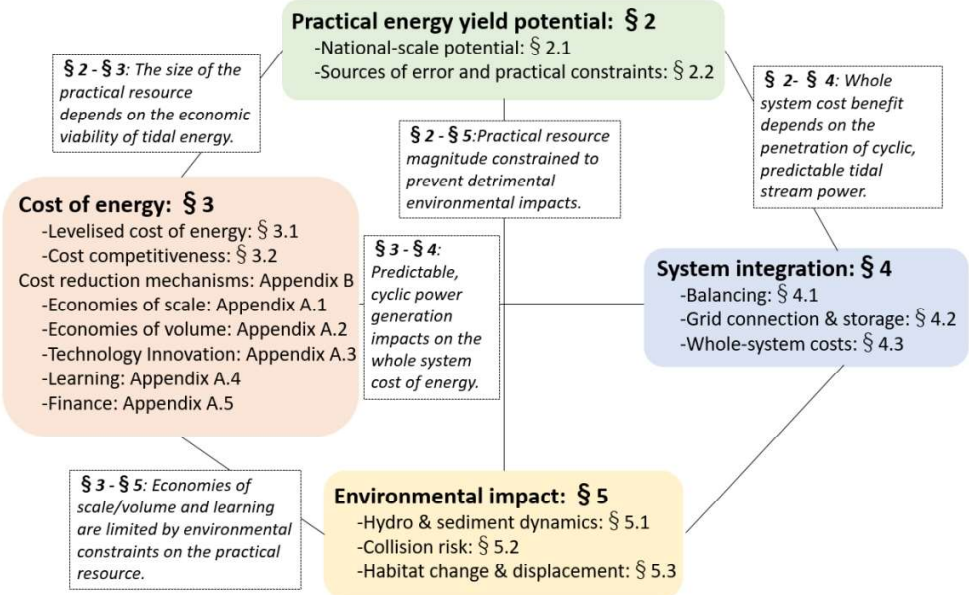


Figure 2: Summary of review topics, with example of how they are related to one another.

845x532mm (38 x 38 DPI)

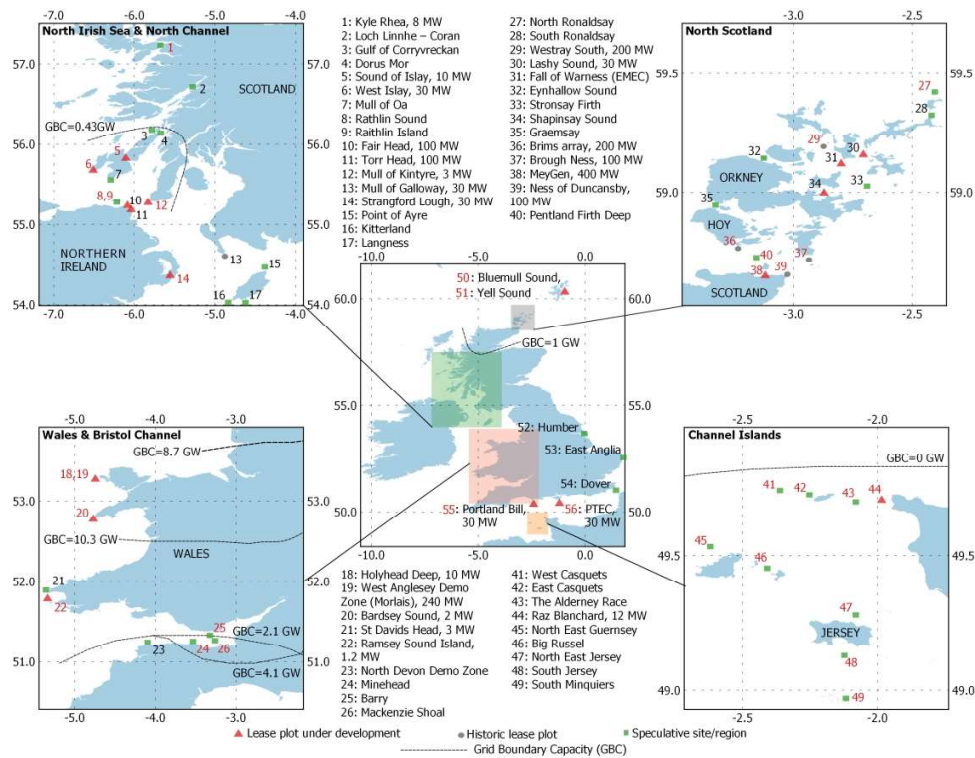


Figure 3: Overview of prospective tidal stream energy lease sites and speculative sites around the UK and British Channel Islands. Red triangles indicate lease plots currently under development, grey circles indicate historic old plots that have been withdrawn, and green squares indicate speculative sites/regions. Red numbers indicate sites/regions considered in the 2011 Carbon Trust study [16]. Relevant electrical grid boundary capacities (GBC) are also illustrated.

751x581mm (118 x 118 DPI)

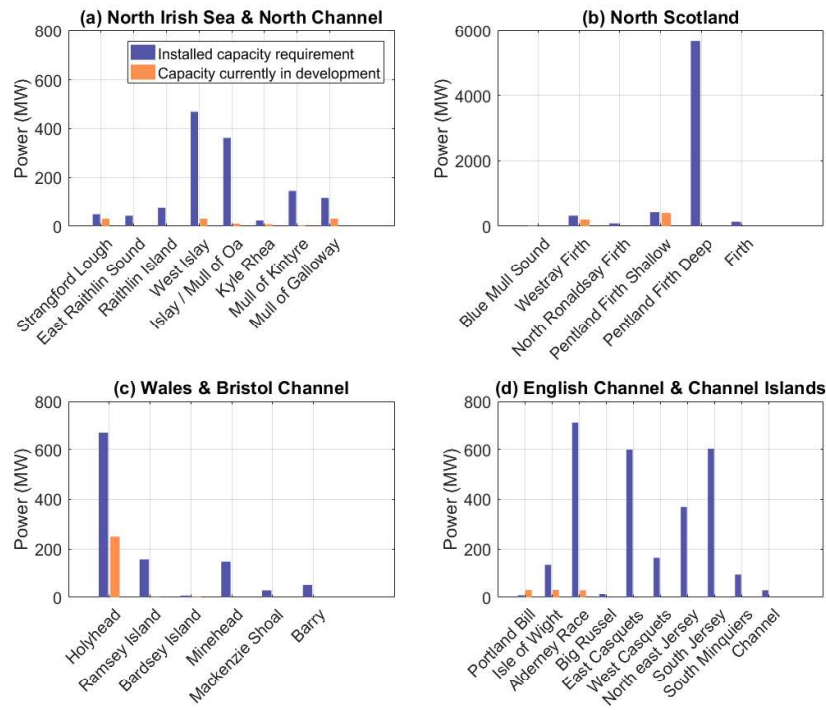


Figure 4: Installed capacity requirement to achieve a practical resource of 34 TWh/year with a capacity factor of 0.34, based on sites used in the 2011 Carbon Trust study [16]. Note that (b) North Scotland has a different y-axis limit, given its larger resource.

793x637mm (38 x 38 DPI)

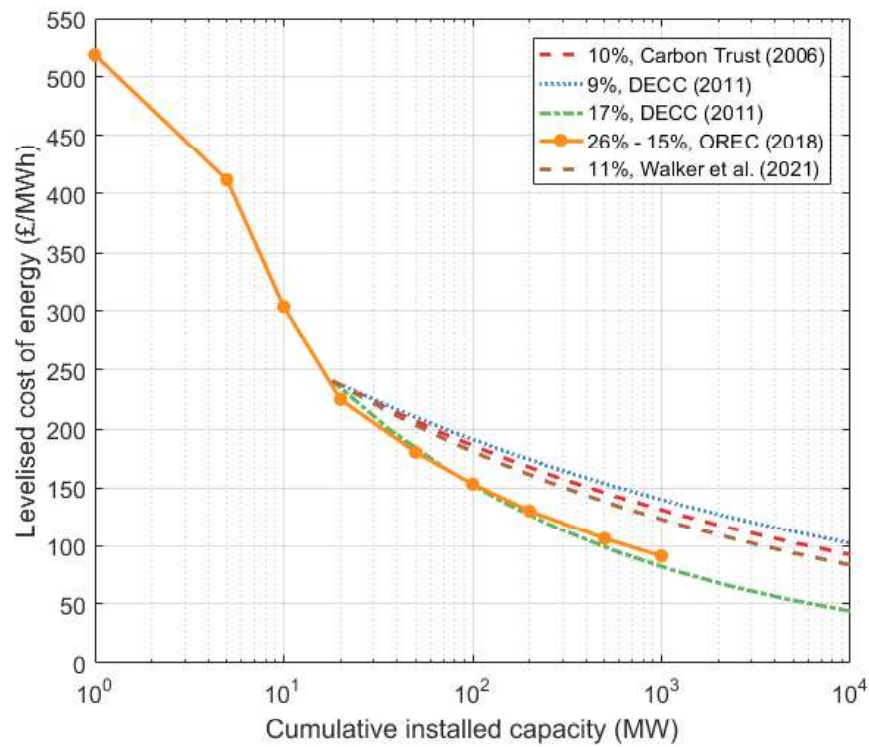


Figure 5: Relationship between cumulative installed capacity and levelised cost of energy, based on a range of technology learning rates reported in literature.

443x360mm (38 x 38 DPI)

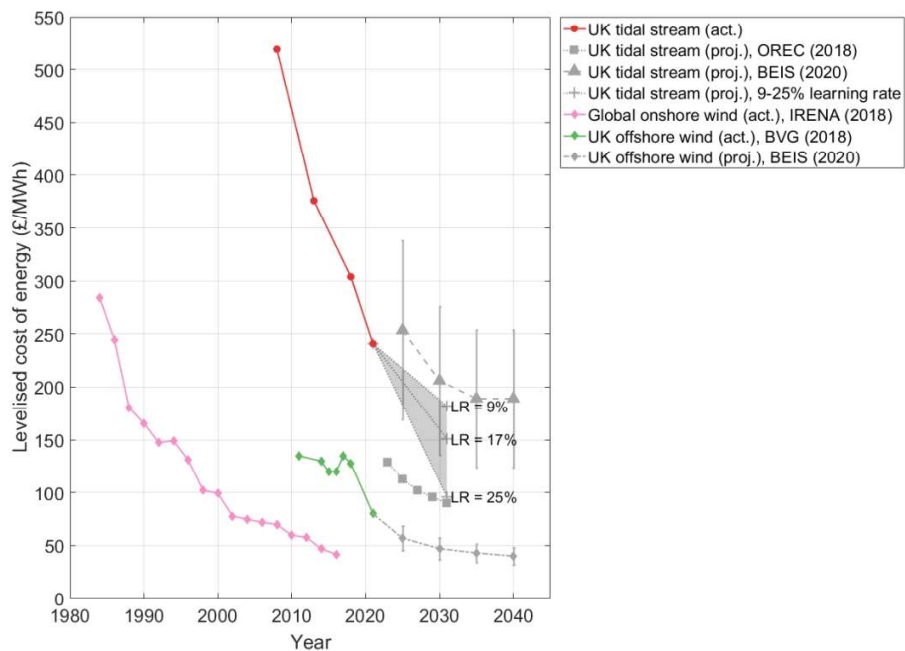


Figure 6: LCoE of tidal stream [4, 44], UK fixed-bed offshore wind [51], and global onshore wind [50], based on actual data from operational projects, and projections. Tidal stream LCoE projections are given based on learning rates (LR) ranging between 9 - 25%.

868x637mm (38 x 38 DPI)

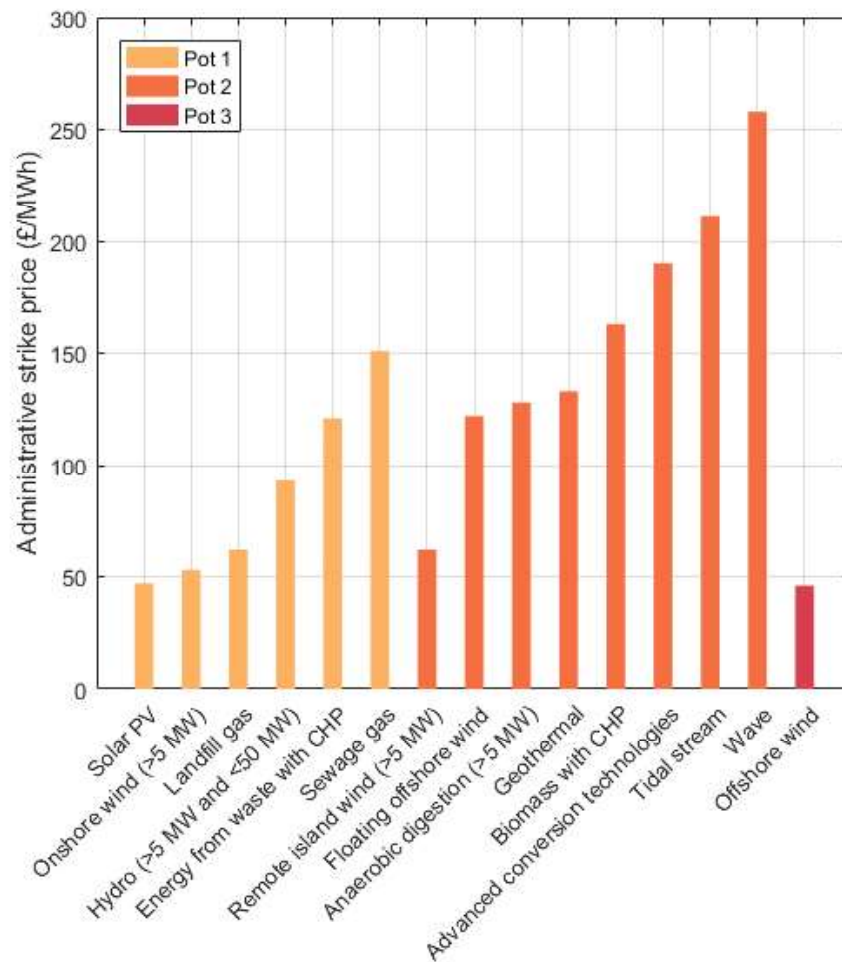


Figure 7: Comparison of AR4 pot 2 technology administrative strike prices, based on 2011/12 prices [15].

374x394mm (38 x 38 DPI)

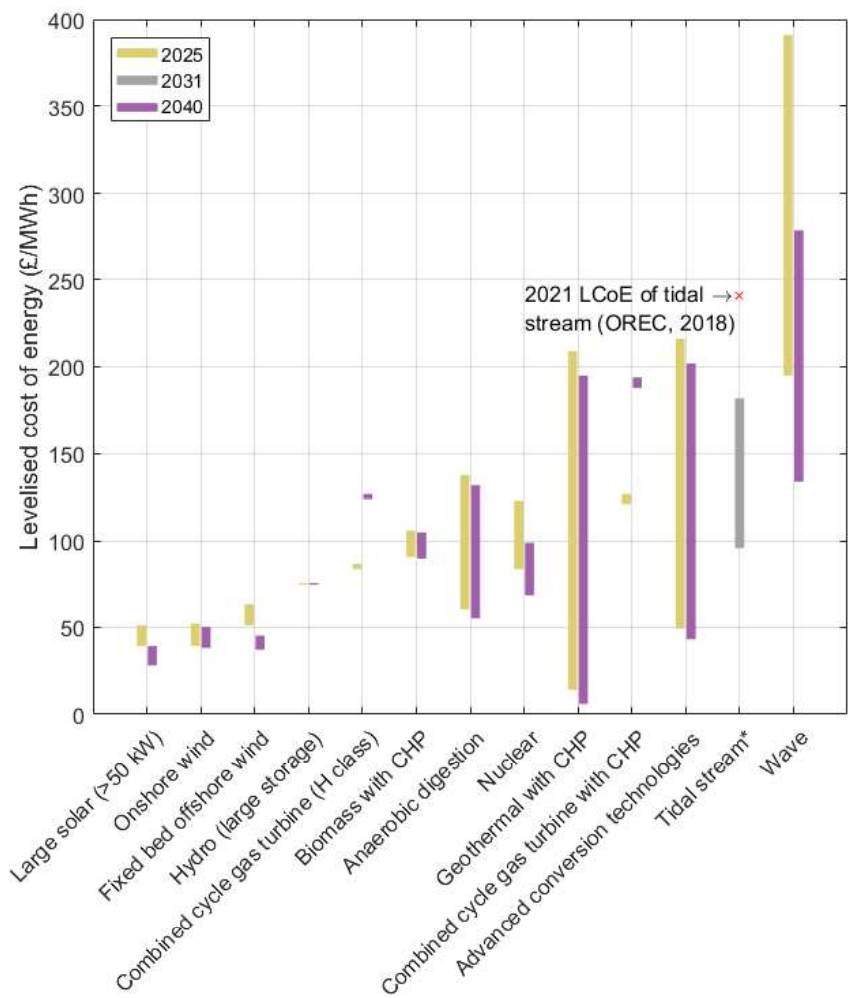


Figure 8: Comparison of 2025, 2031 and/or 2040 LCoE projections for different technologies [44], based on 2011/12 prices.
*Tidal stream projection based on findings presented in this review

477x521mm (38 x 38 DPI)

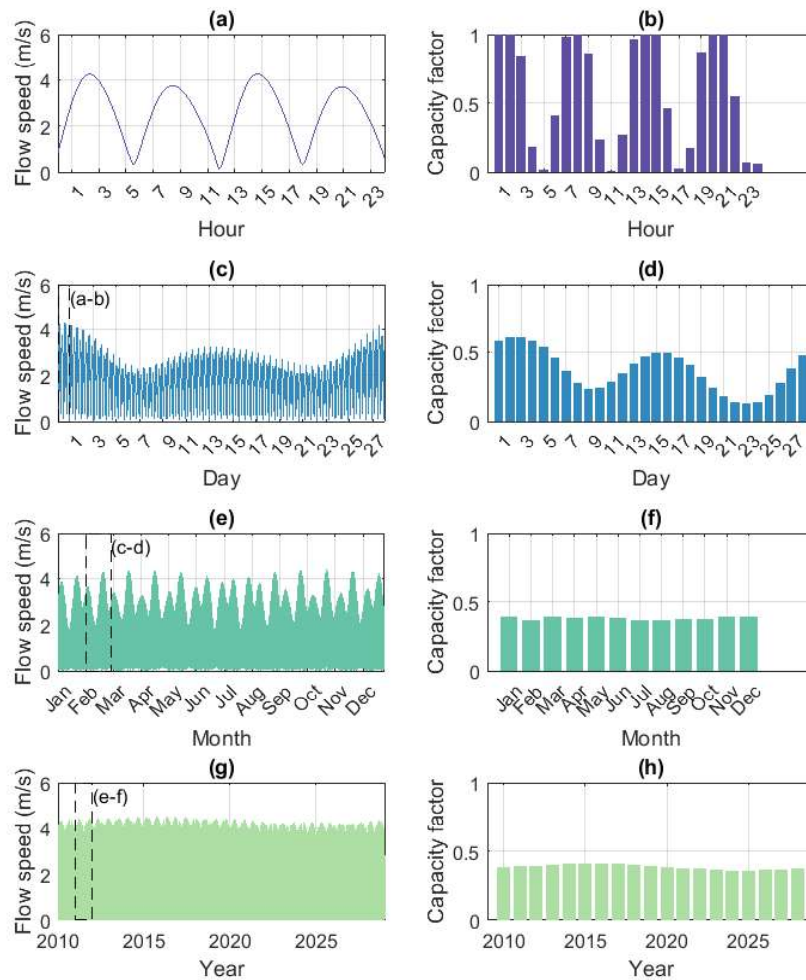


Figure 9: Demonstration of the cyclic, predictable nature of tidal flow and generated power, over timescales of (a-b) a single day, (c-d) a month, (e-f) a year, and (g-h) 19 years.

544x637mm (38 x 38 DPI)